



Tolerance	
<3.00	±0.01
>3.00	±0.02

UNIT = METER

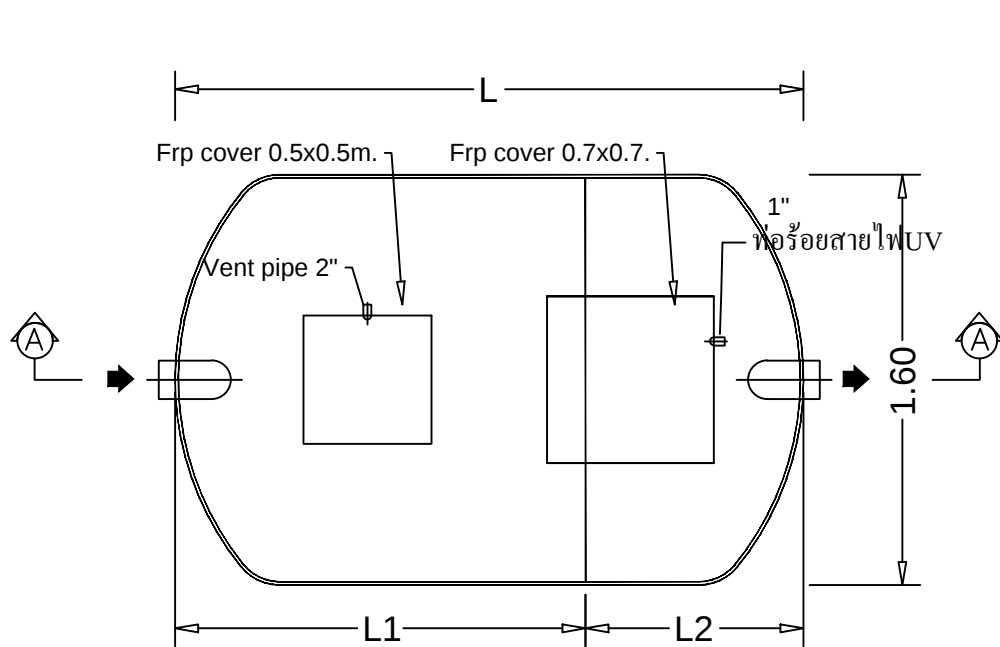

PLAN VIEW

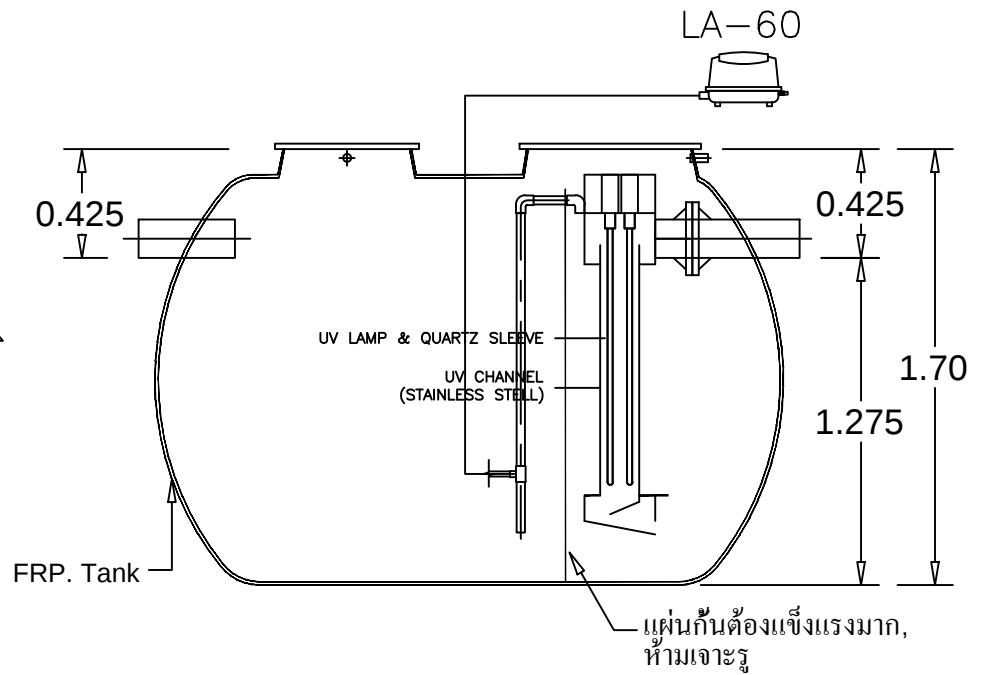

SECTION A-A

STAR "SBUV-95" TANK SPECIFICATION

MODEL	W (m.)	L (m.)	H (m.)	BLAZOR UV Model	No. of Lamp/ Lamp Watts	INLET (dia.)	OUTLET (dia.)	L1 (m.)	L2 (m.)
SBUV-95	1.60	2.00	1.70	BU 3602V	2 / 80	ø6"	ø6"	1.15	0.85

Client				Maesod International Hospital							
Title				STAR DISINFECTION TANK MODEL SBUV-95							
Scale				NTS.							
Drawn	Date	Approved	Date	Drawing No.	Rev.						
Chonticha	8-1-59	Abunna	8-1-59	Fac_013-1/59	Rev.0						