


Tolerance

<3.00 ±0.01

>3.00 ±0.02

UNIT = METER

STAR TANK MODEL STD-9500

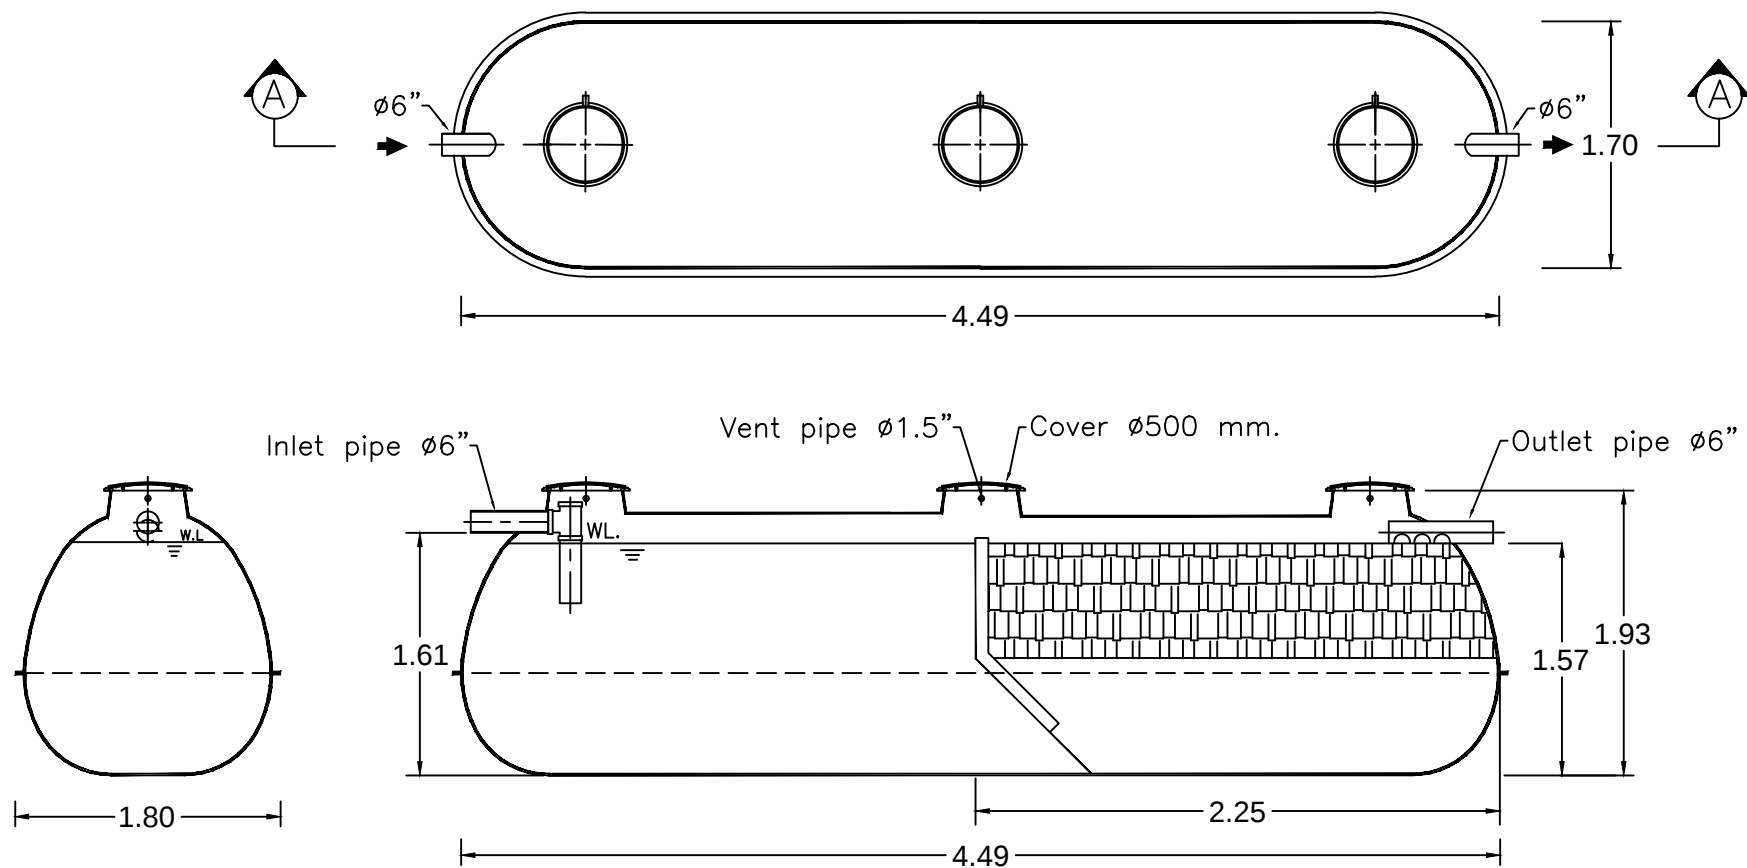

SECTION A-A

Client					
โครงการ ถังบำบัดน้ำเสีย					
Title					Scale
STAR STD-9500 For Factory					NTS.
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	23-2-59	<i>Wanna</i>	23-2-59	Fac_058-1/59	Rev.0

