
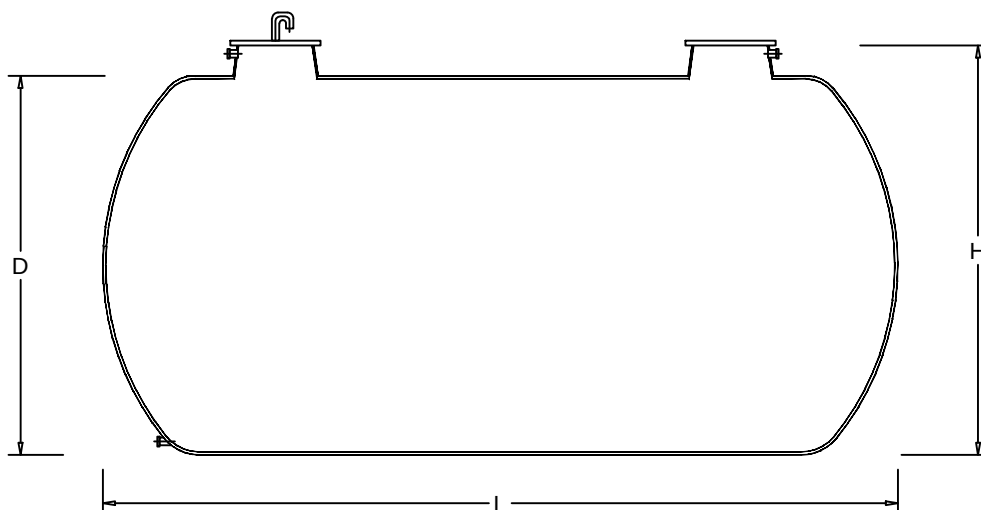


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

STAR WATER STORAGE TANK (UNDERGROUND)

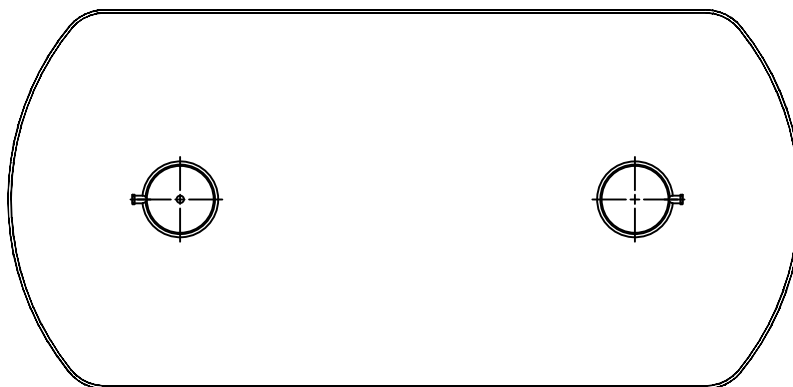

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
STW-2555	12.20	2.70	2.50	ø0.50	ø3"	ø3"	ø2"

Client โครงการ ถังเก็บน้ำใต้ดิน							
Title STW-2555 For Factory						Scale NTS.	
Drawn Cholticha K.	Date 23-2-59	Approved <i>Uthairat</i>	Date 23-2-59	Drawing No. Fac_058-2/59	Rev. Rev.0		

