


Tolerance	
<3.00	±0.01
>3.00	±0.02

FM-DD-04

UNIT = METER

UNCONTROLLED DOCUMENT

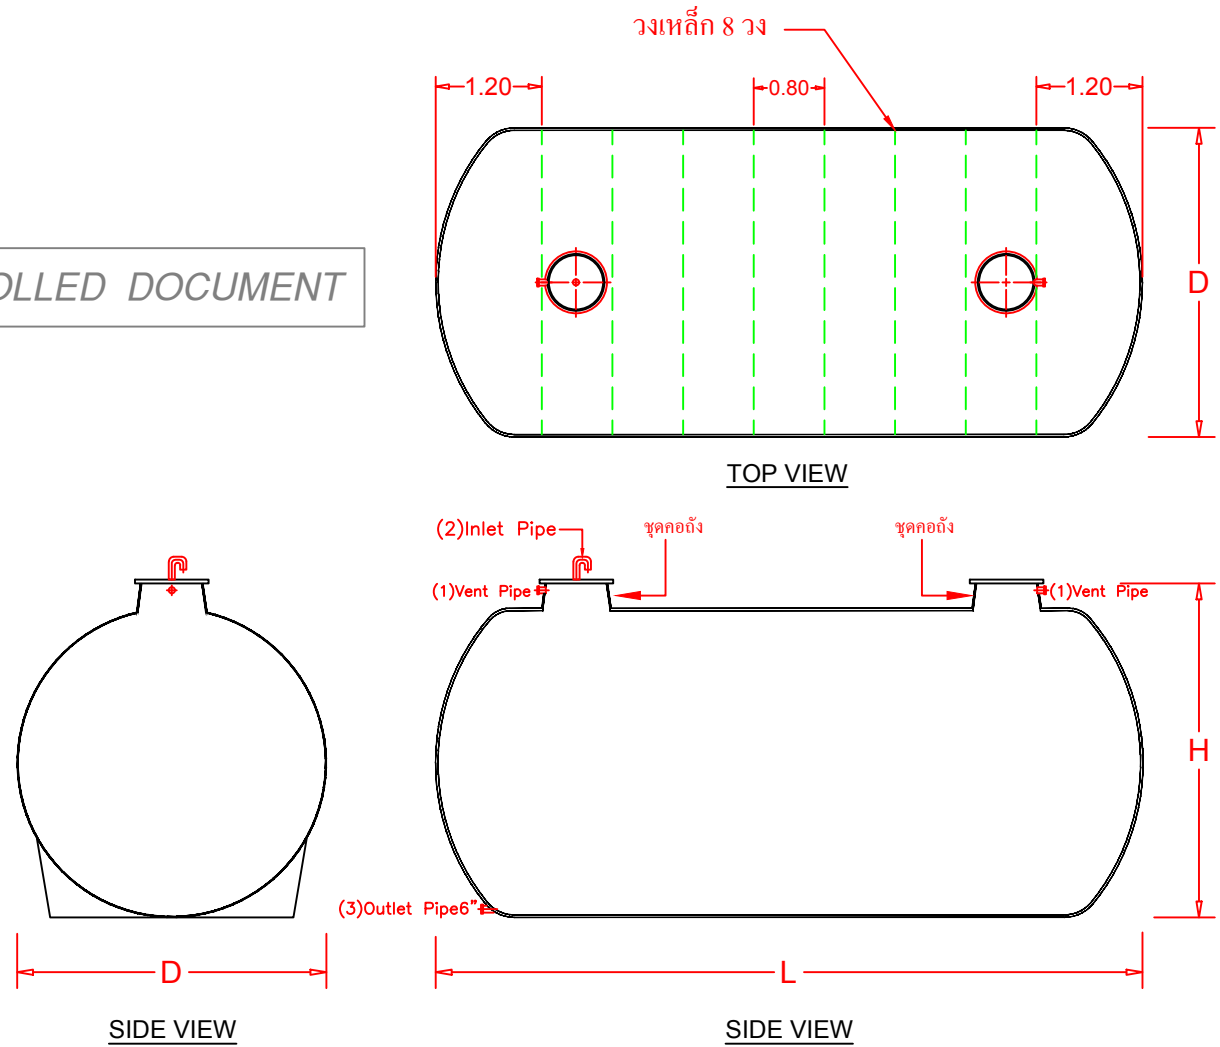

SPECIFICATION

MODEL	CAPACITY (Cu.m.)	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SWO-2535	35.3	8.00	2.70	2.50	Ø0.50	Ø3"	Ø3"	Ø2"

Client						
โครงการ Tesco Lotus สติ๊ก จ.บุรีรัมย์						
Title				Scale		
STAR Water Storage Tank Model SWO-2535				NTS.		
Drawn	Date	Approved	Date	Drawing No.	Rev.	
Cholticha	7-7-59		7-7-59	Fac_173/59	Rev.0	