


Tolerance	
<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK
(UNDERGROUND)

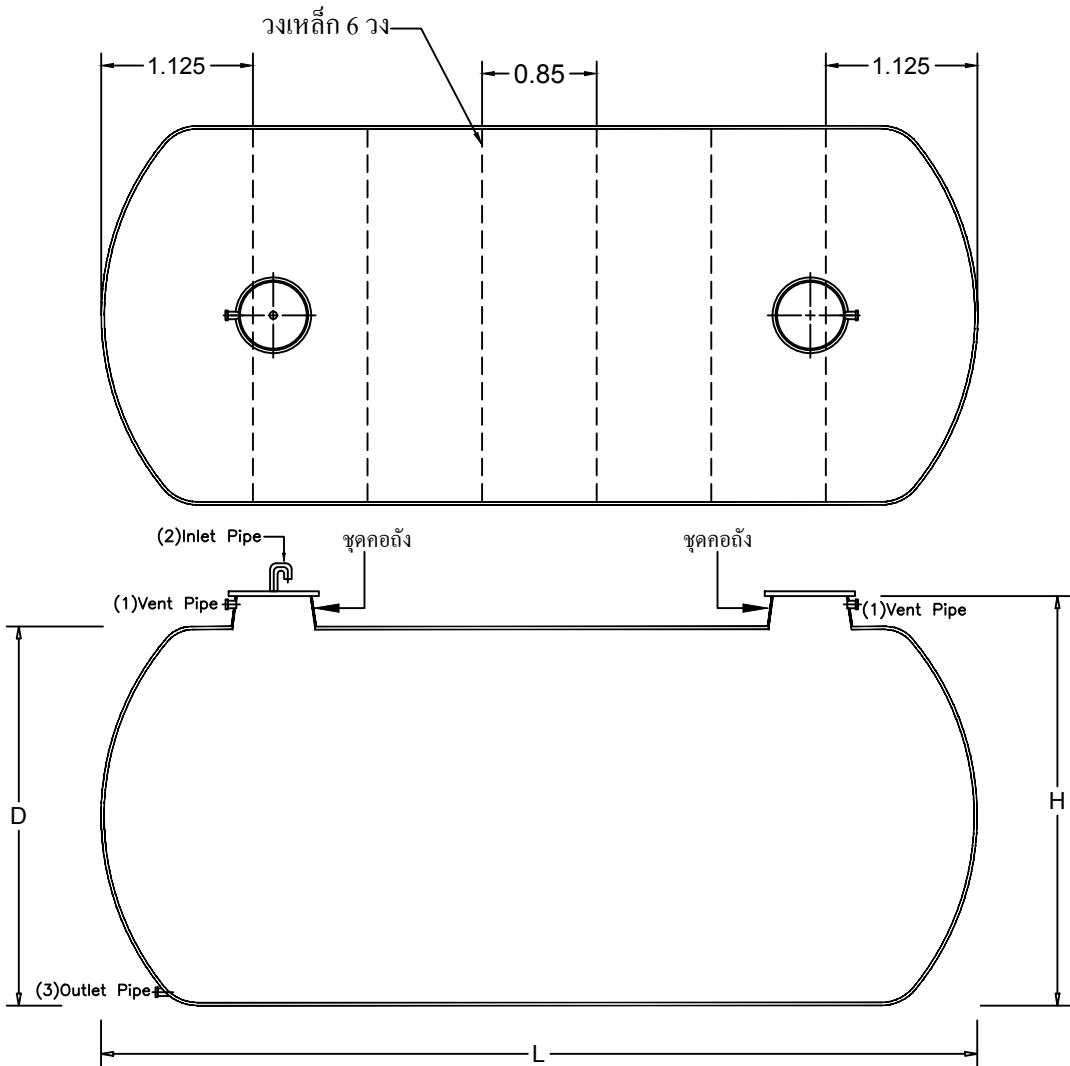

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
UC-20000	6.50	2.15	2.00	ø0.50	ø2"	ø2"	ø2"

Client				โครงการ ถังเก็บน้ำไฟเบอร์กลาส			
Title						Scale	
STAR UC-20000 For Factory						NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.		
Chonticha	15-8-59	Wanna	15-8-59	Fac_198-1/59	Rev.0		

