



Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

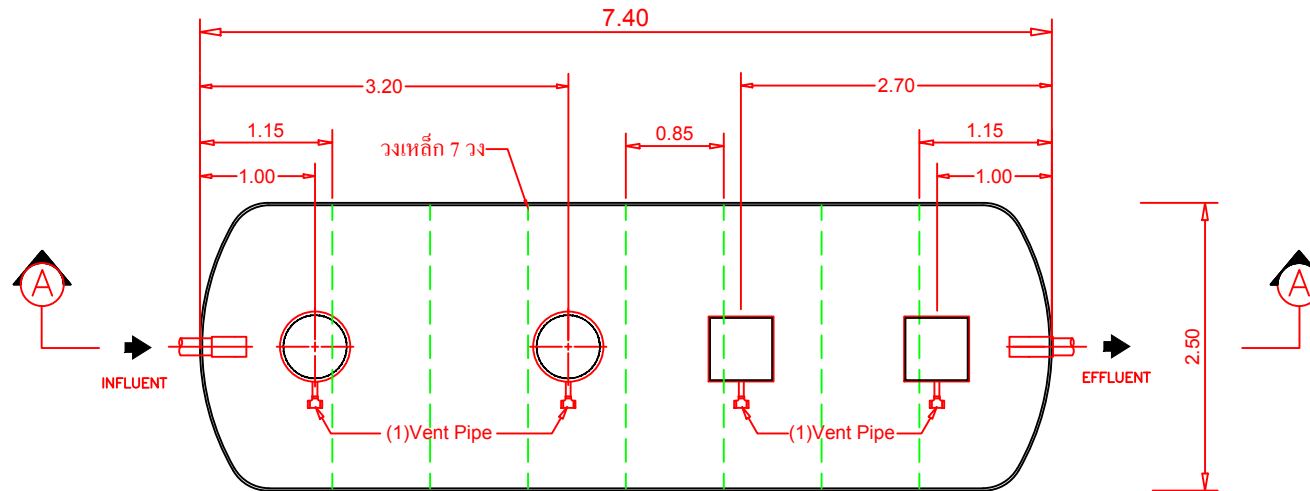

STAR TANK MODEL WSA-2532Z

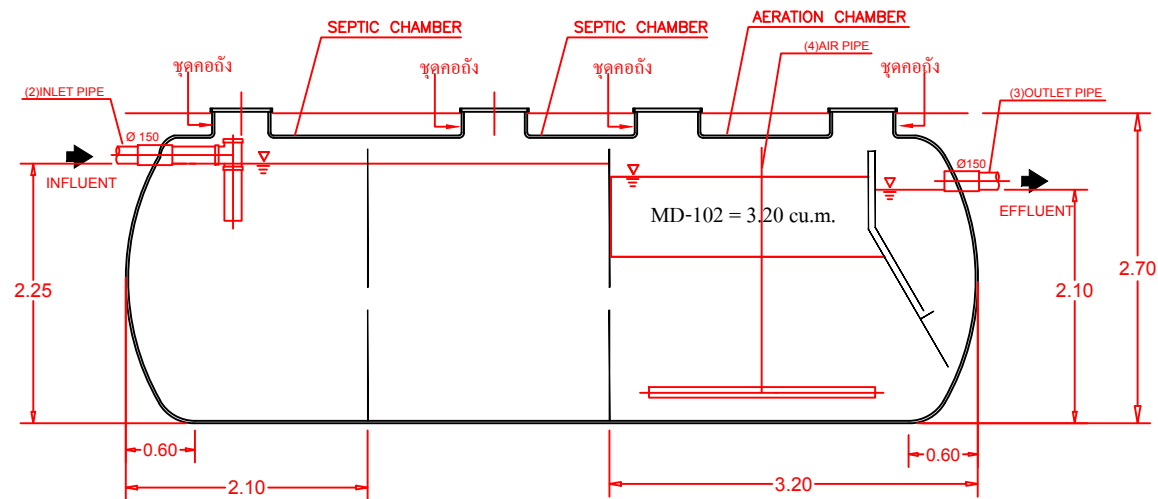

SECTION A-A

UNCONTROLLED DOCUMENT

FM-DD-04

Client		ตั้งบ่อบำบัดน้ำเสียไฟเบอร์กลาส			
Title		STAR TANK MODEL WSA-2532Z			Scale NTS.
Drawn Chonticha	Date 22-8-59	Approved <i>U...</i>	Date 22-8-59	Drawing No. Fac_201/59	Rev. Rev.0

