


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK (UNDERGROUND)

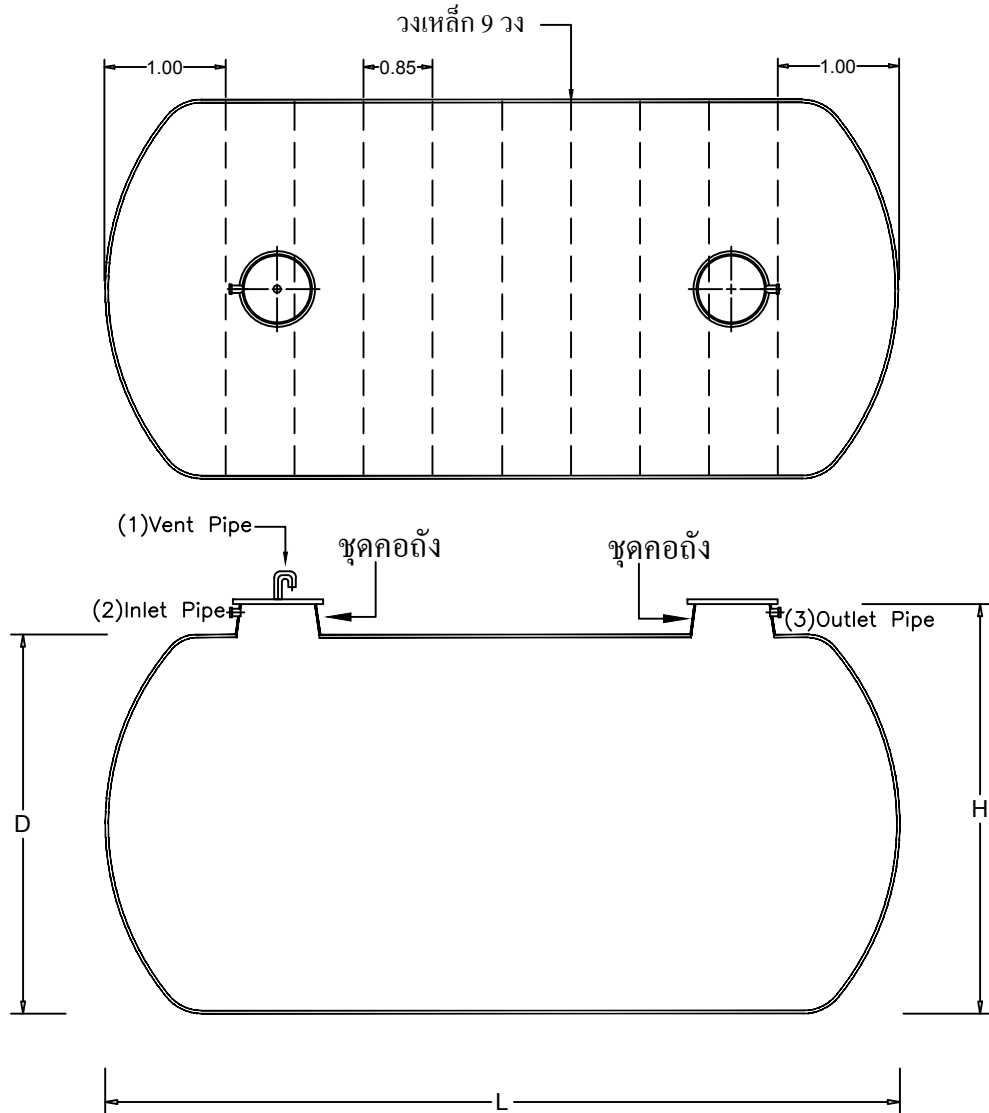

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SW-2025	8.80	2.15	2.00	Ø0.50	Ø2"	Ø3"	Ø2"

Client				โครงการ THE TREASURE CONDO			
Title				SW-2025 For Factory		Scale	NTS.
Drawn	Date	Approved	Date	Drawing No.	Rev.		
Cholticha K.	30-11-59	<i>Umsamee</i>	30-11-59	Fac_293-2/59	Rev.0		