


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

STAR TANK MODEL SSS-3133

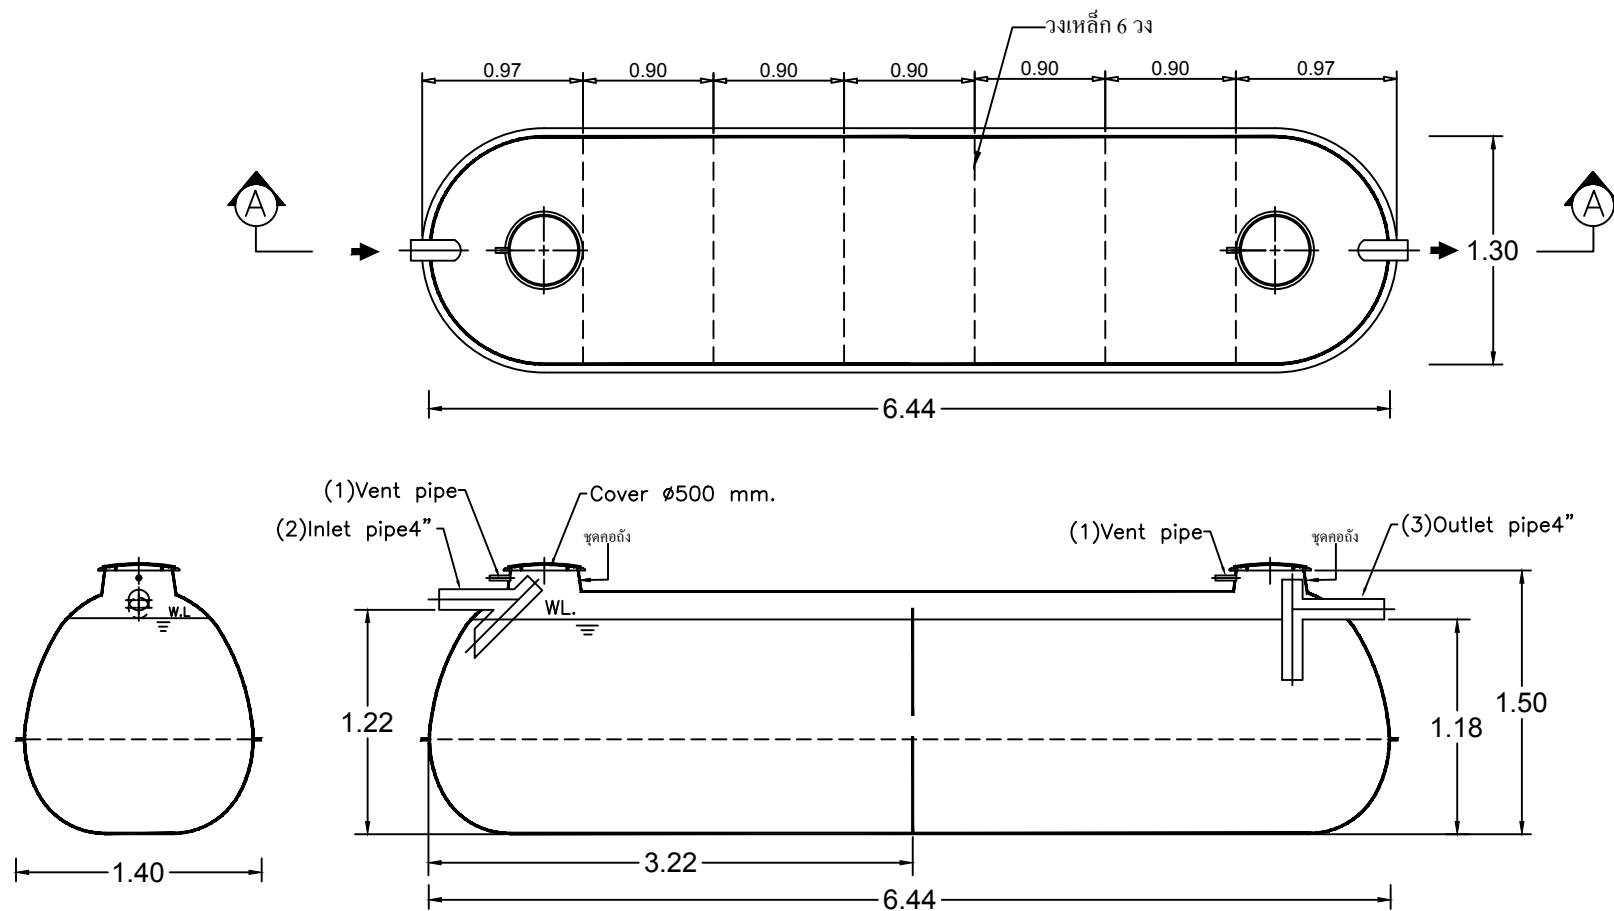

UNCONTROLLED DOCUMENT

Client		โครงการ ถังบำบัดน้ำเสีย บ.วิไทยฯ			
Title		STAR SSS-3133 For Factory			Scale NTS.
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	13-7-60	<i>Wanna</i>	13-7-60	Fac_158/60	Rev.0

