


Tolerance	
<3.00	±0.01
>3.00	±0.02

FM-DD-04

UNIT = METER

STAR TANK MODEL PS-1600

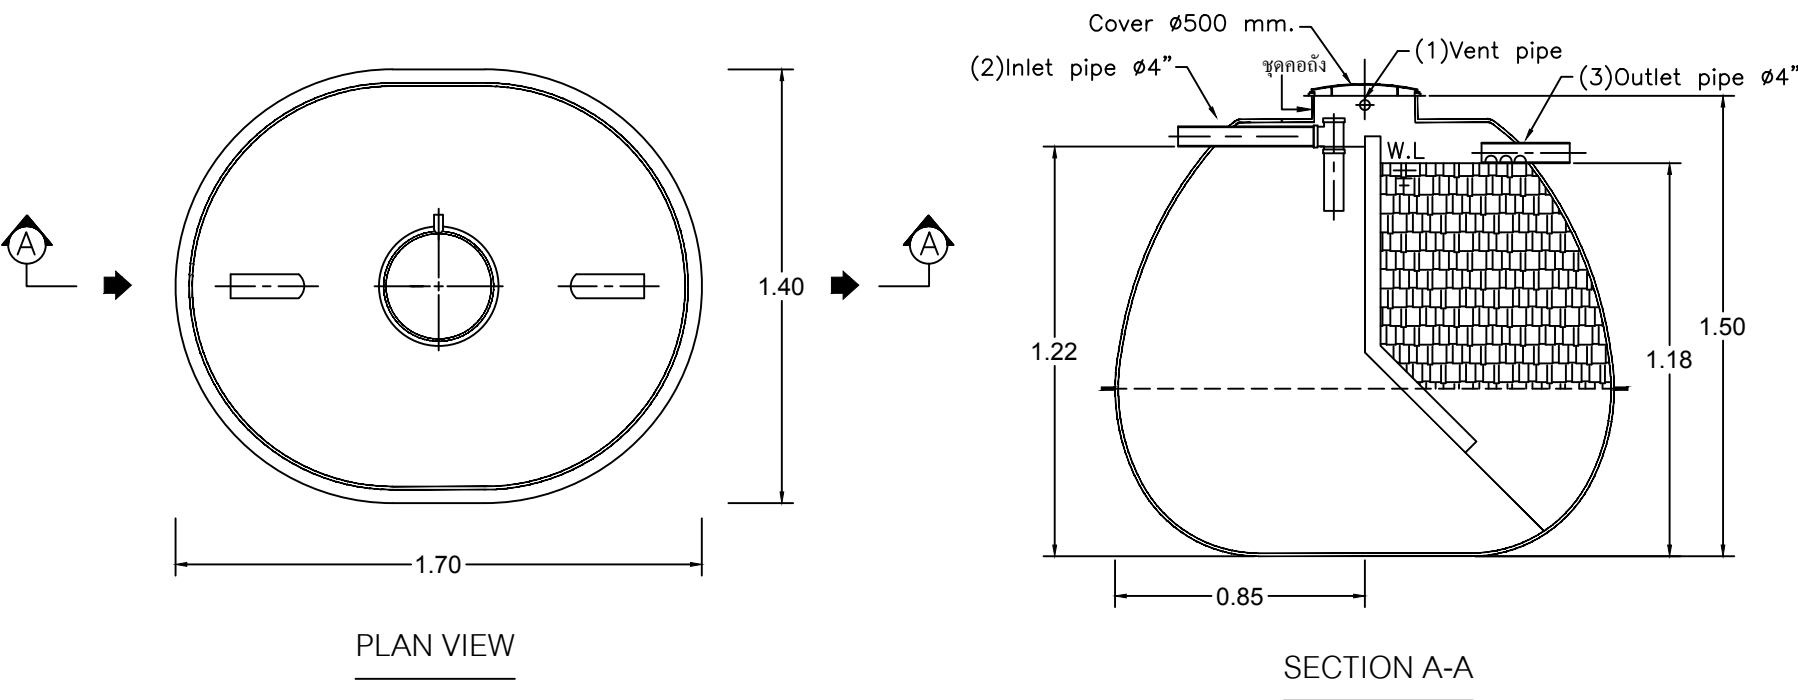

UNCONTROLLED DOCUMENT

Client					
โครงการ ถังบำบัดน้ำเสีย					
Title				Scale	
STAR PS-1600 For Factory				NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.
CHOLTICHA K.	19-7-60	<i>Wanwanee</i>	19-7-60	Fac_159-1/60	Rev.0

