

Tolerance


<3.00 ±0.01

>3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK (ONGROUND)

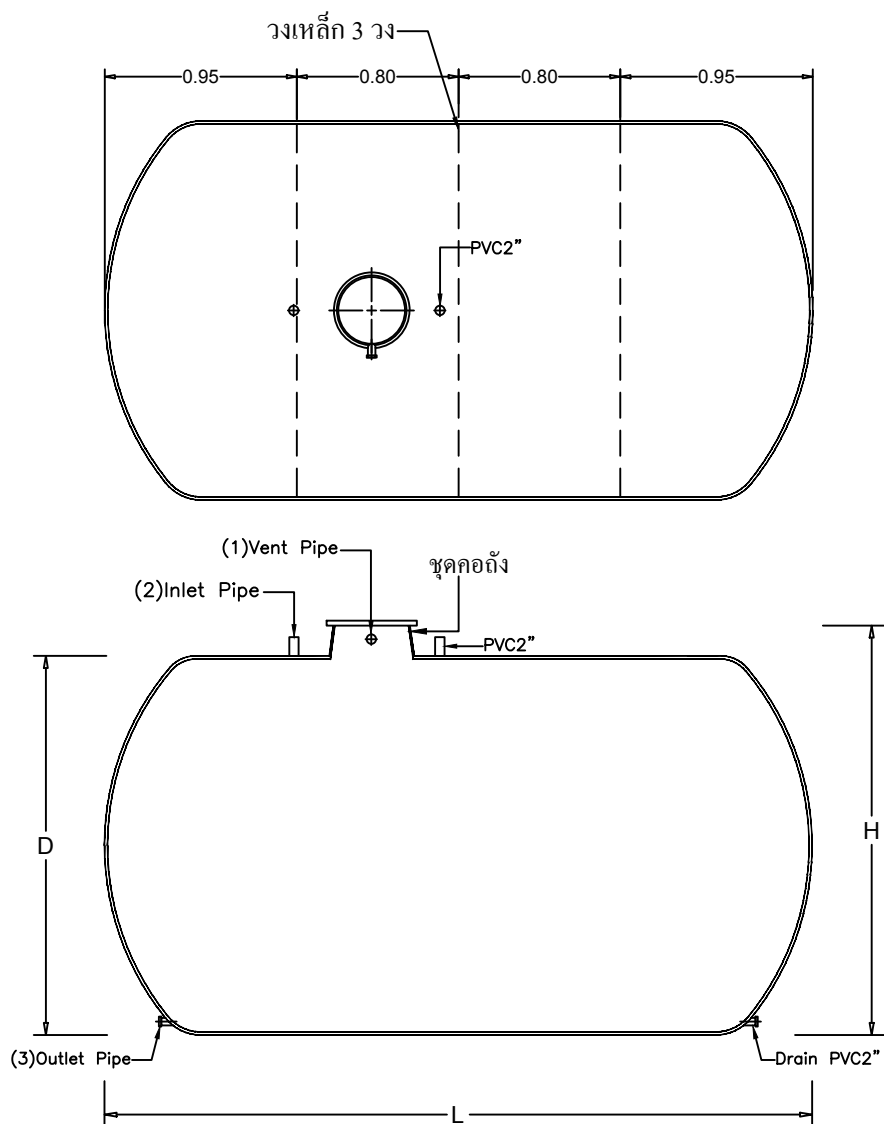

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
WT-TOT-10Q	3.50	2.20	2.00	ø0.50	ø2"	ø2"	ø2"

Client

โครงการ พัทยา จ.ชลบุรี

Title

WT-TOT-10Q For Factory

Scale

NTS.

Drawn
Cholticha K.Date
29-8-60Approved
*Umsame*Date
29-8-60Drawing No.
Fac_193/60Rev.
Rev.0
PROUD
ASIA