


Tolerance	
<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

STAR TANK MODEL PS-2340

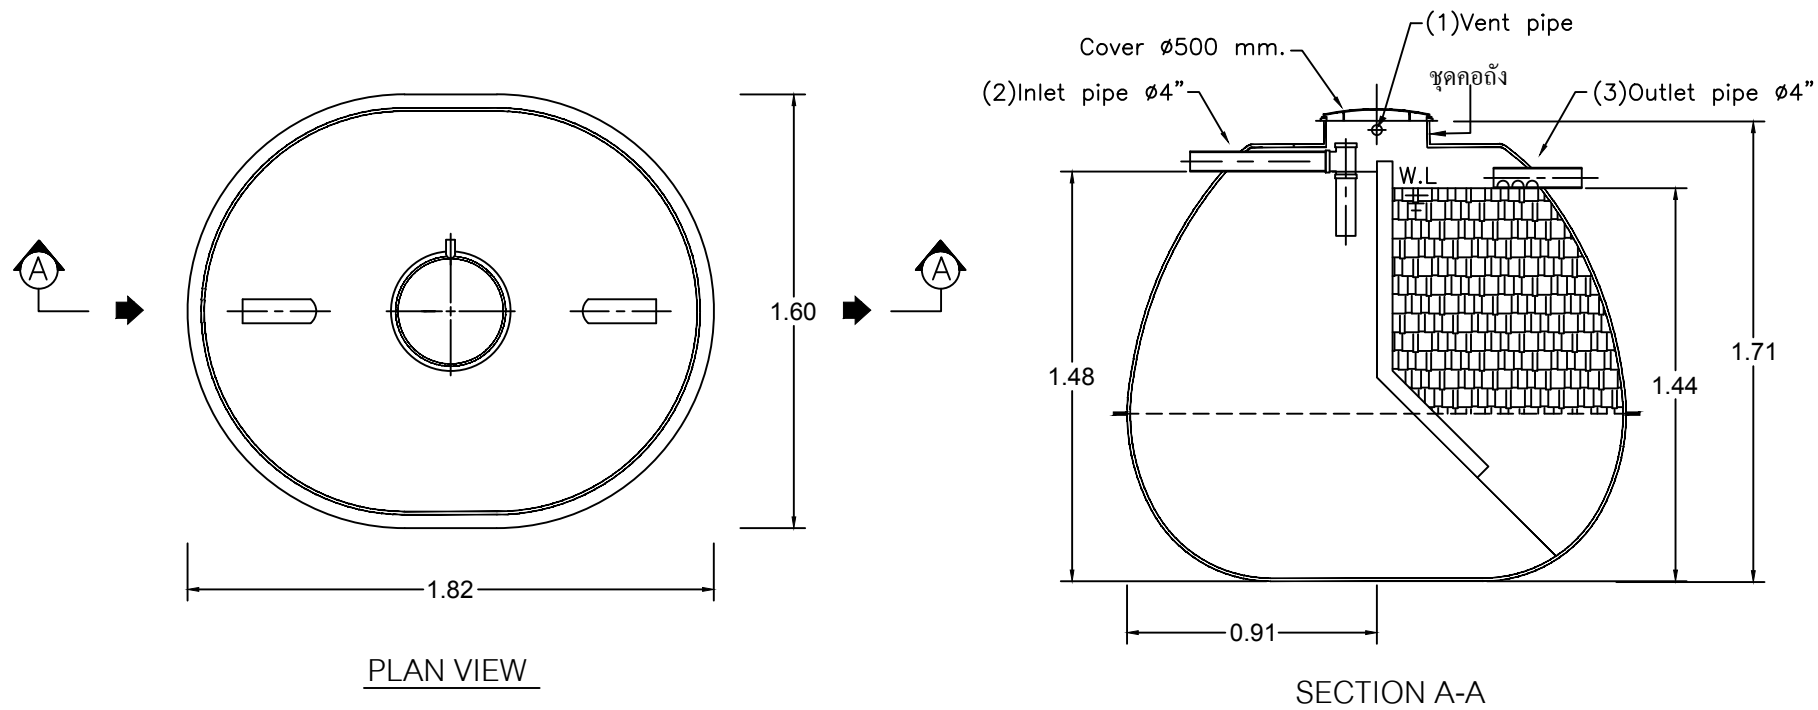

UNCONTROLLED DOCUMENT

Client		โครงการ ถังบำบัดน้ำเสีย			
Title		STAR PS-2340 For Factory			Scale NTS.
Drawn Chonticha	Date 29-9-60	Approved <i>Umm...</i>	Date 29-9-60	Drawing No. Fac_227/60	Rev. Rev.0

