


Tolerance	
<3.00	±0.01
>3.00	±0.02


FM-DD-04

UNIT = METER

STAR WATER STORAGE TANK MODEL SWTG-2000

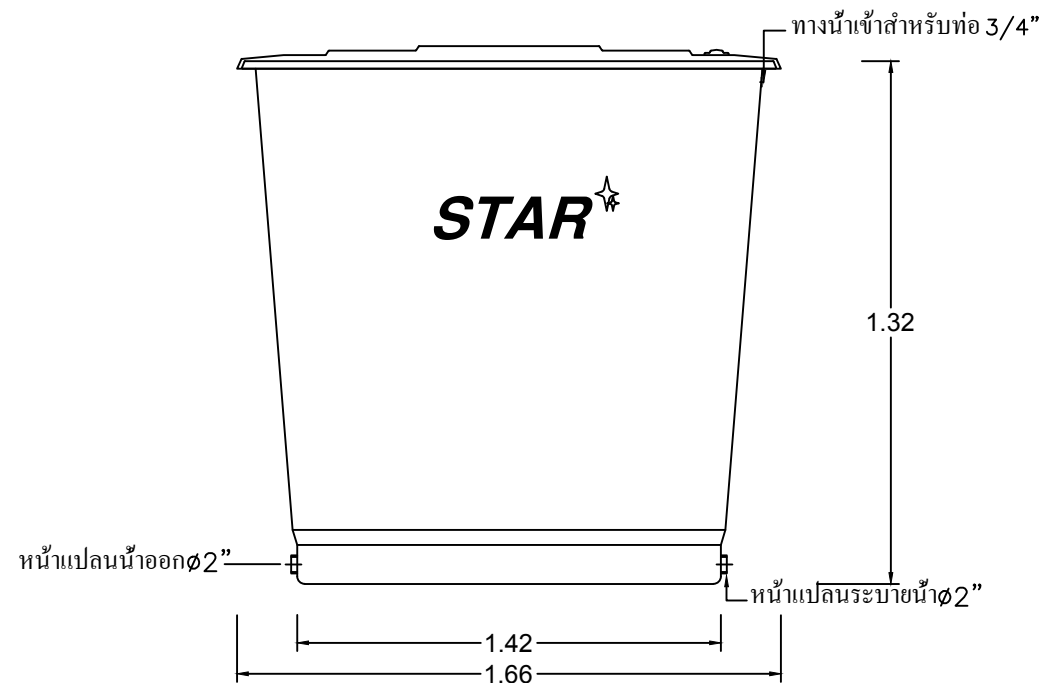

UNCONTROLLED DOCUMENT

Client						
โครงการ ถังเก็บน้ำ 2000 ลิตร						
Title				Scale		
STAR WATER TANK SWTG-2000 For Factory				NTS.		
Drawn	Date	Approved	Date	Drawing No.	Rev.	
Chonticha	10-10-60	<i>Ummee</i>	10-10-60	Fac_229/60	Rev.0	