


Tolerance

<3.00	±0.01
>3.00	±0.02


UNIT = METER

UNCONTROLLED DOCUMENT


FM-DD-04

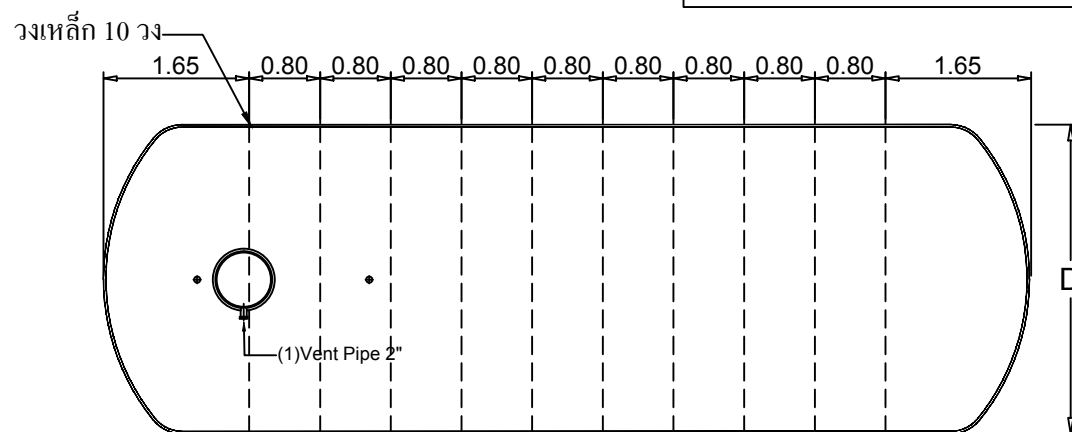

TOP VIEW

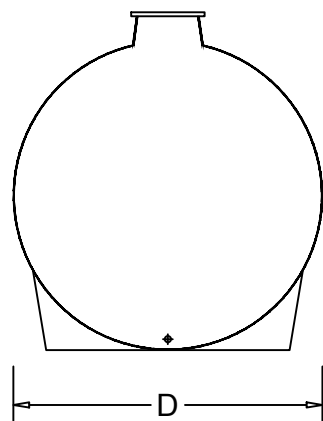

SIDE VIEW

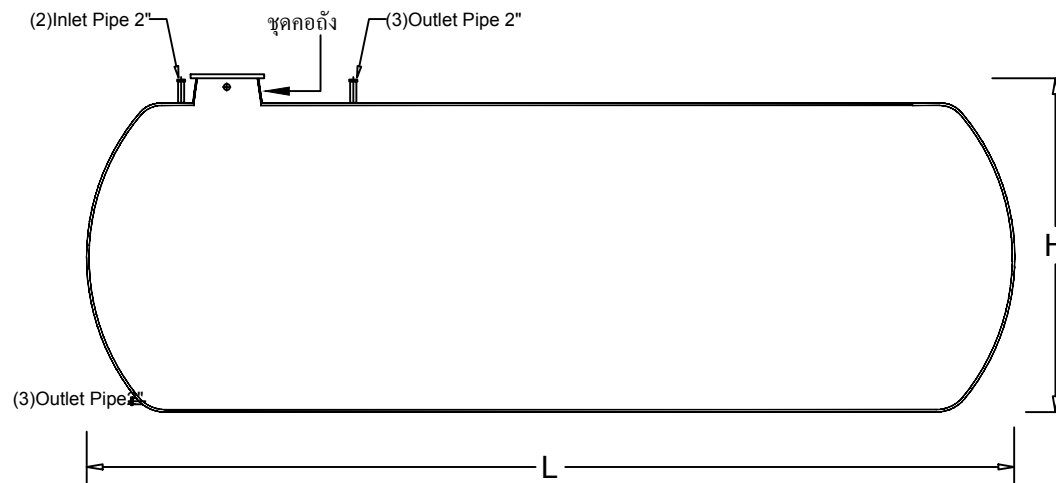


SECTION

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)
WT-TOT-100Q	10.50	3.70	3.50	Ø0.50

Client โครงการ จ.นครราชสีมา					
Title STAR Water Storage Tank Model WT-TOT-100Q				Scale NTS.	
Drawn Chonticha	Date 10-10-60	Approved <i>Umsunee</i>	Date 10-10-60	Drawing No. Fac_230/60	Rev. Rev.0



PROUD
ASIA