


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT


STAR WATER STORAGE TANK (UNDERGROUND)

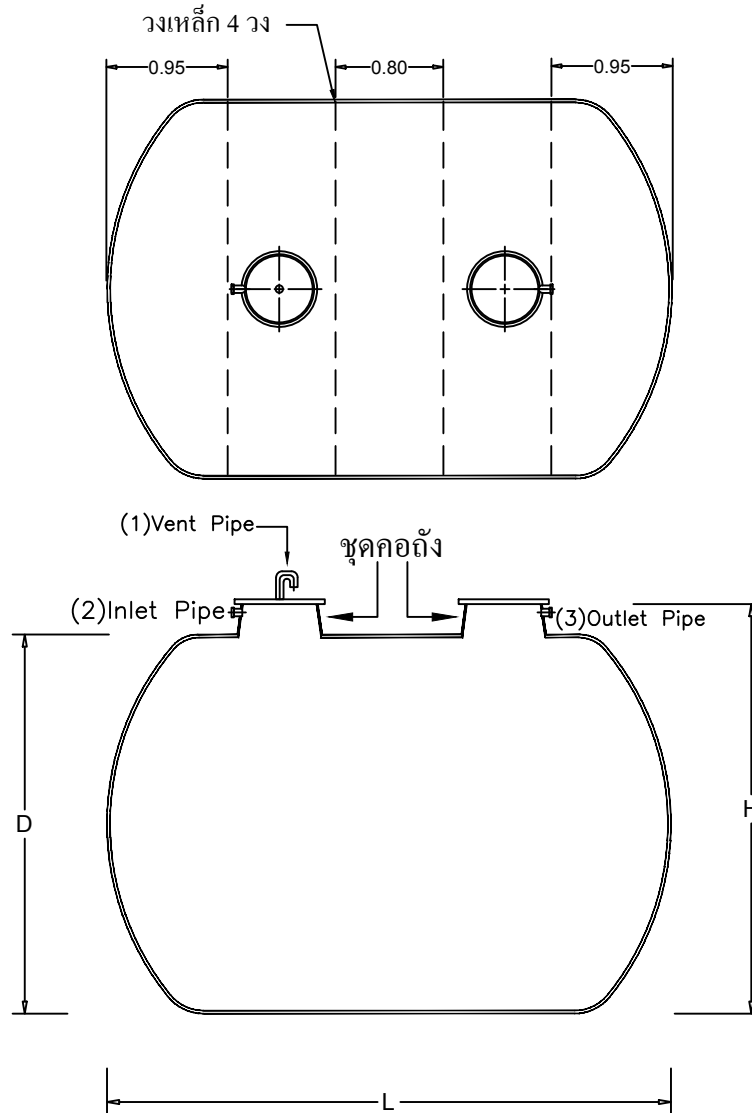

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
HRU-30K	4.30	3.20	3.00	Ø0.50	Ø2"	Ø3"	Ø2"

Client				โครงการ ถังเก็บน้ำชนิดฝังดิน			
Title						Scale	
HRU-30K For Factory						NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.		
Cholticha K.	17-1-61	<i>Ummee</i>	17-1-61	Fac_010-2/61	Rev.0		



PROUD
ASIA