

Tolerance


<3.00 ±0.01

>3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK (ONGROUND)

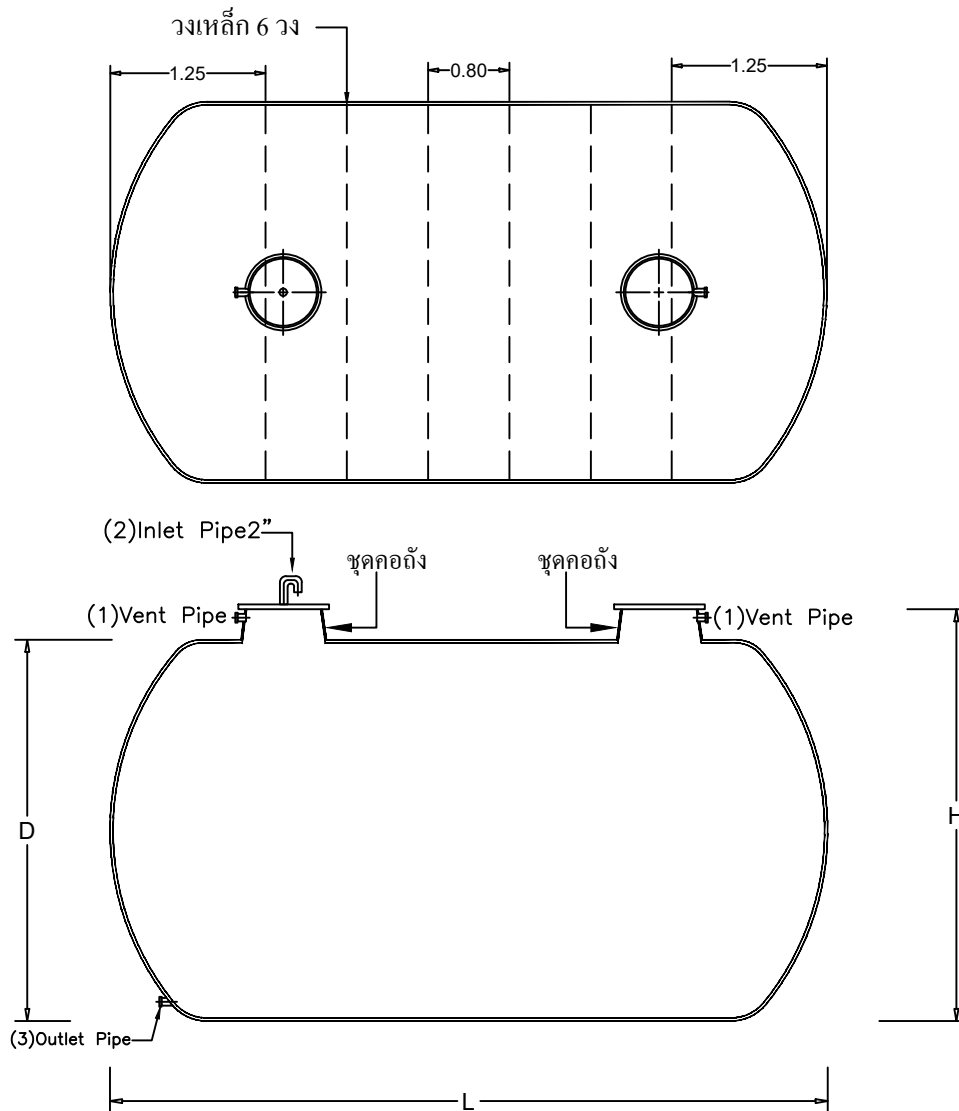

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
WT-TOT-20Q	6.50	2.15	2.00	Ø0.50	Ø2"	Ø3"	Ø2"

Client

โครงการ จ.สระบุรี

Title

WT-TOT-20Q For Factory

Scale

NTS.

Drawn

Cholticha K.

Date

23-1-61

Approved

[Signature]

Date

23-1-61

Drawing No.

Fac_016/61

Rev.

Rev.0


PROUD
ASIA