


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT


STAR WATER STORAGE TANK (UNDERGROUND)

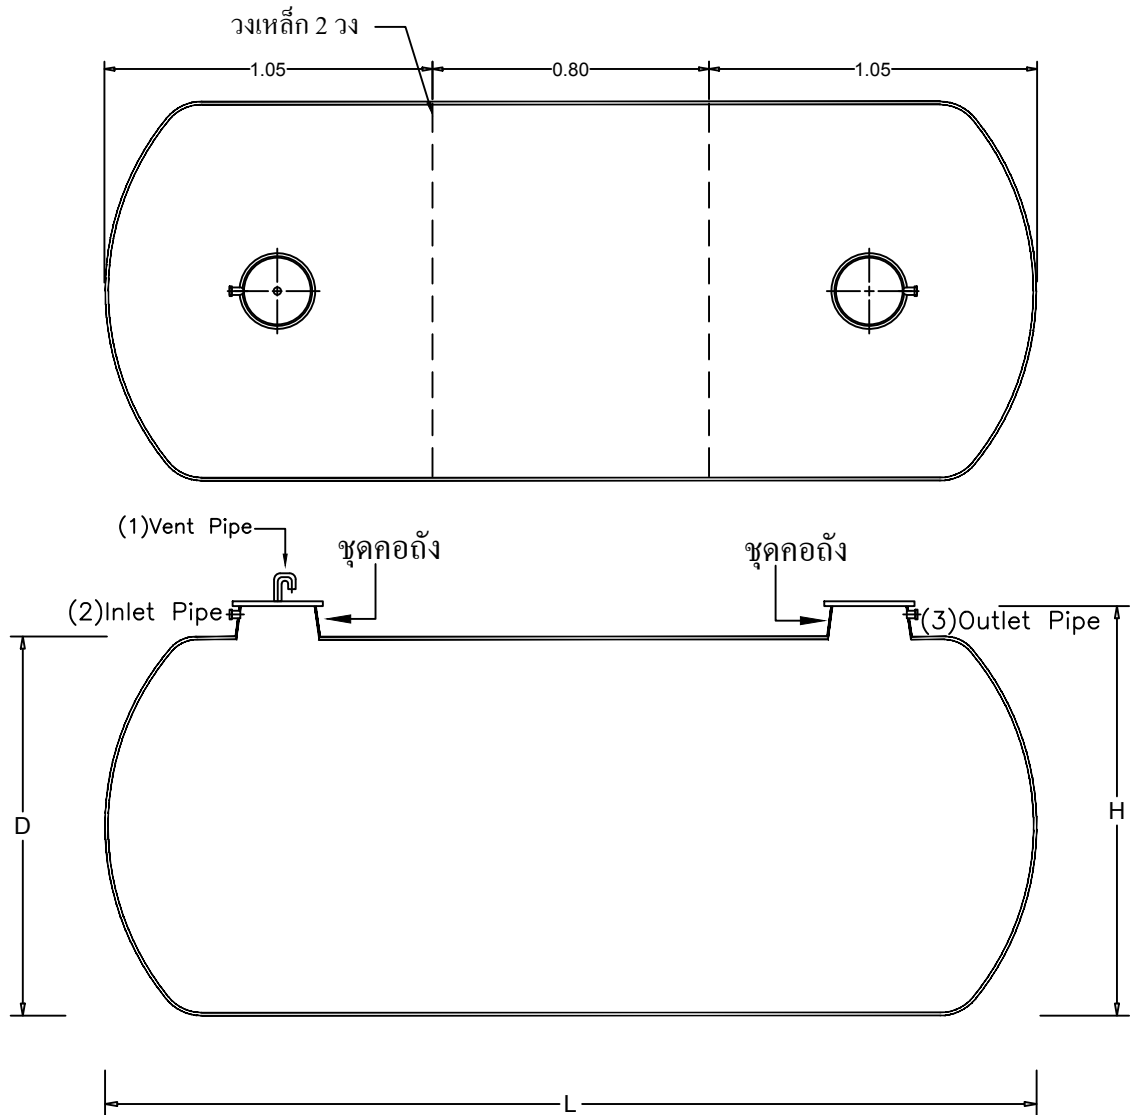

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SW-165	2.90	1.70	1.60	Ø0.50	Ø2"	Ø2"	Ø2"

Client				โครงการ สวนน้ำ อุดรธานี			
Title						Scale	NTS.
SW-165 For Factory							
Drawn	Date	Approved	Date	Drawing No.	Rev.		
Cholticha K.	31-1-61	<i>Uthairat</i>	31-1-61	Fac_031-2/61	Rev.0		



PROUD
ASIA