

# Tolerance


<3.00 ±0.01

>3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

## STAR WATER STORAGE TANK (UNDERGROUND)

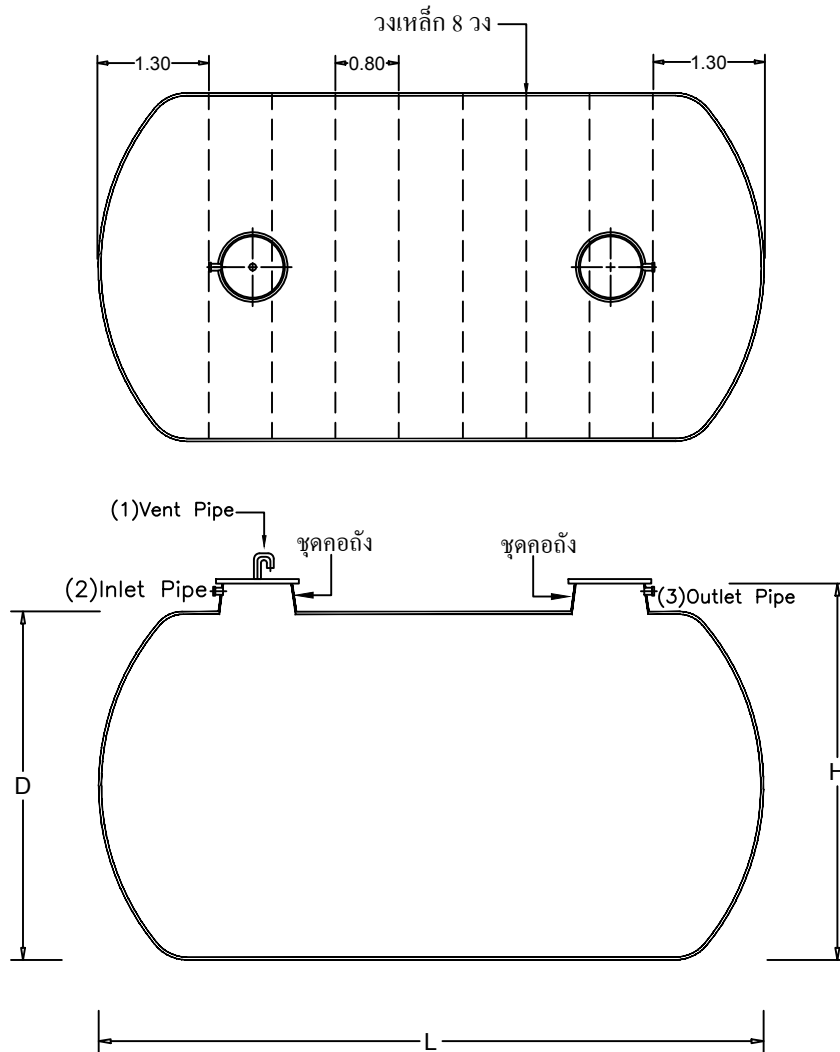

### SPECIFICATION

| MODEL   | LENGTH<br>(m.) | HEIGHT<br>(m.) | DIAMETER<br>(m.) | COVER<br>(m.) | INLET<br>(inc.) | OUTLET<br>(inc.) | AIR VENT<br>(inc.) |
|---------|----------------|----------------|------------------|---------------|-----------------|------------------|--------------------|
| SW-2536 | 8.20           | 2.70           | 2.50             | Ø0.50         | Ø3"             | Ø3"              | Ø2"                |

|              |        |                |        |                             |       |                                                                                                                      |      |
|--------------|--------|----------------|--------|-----------------------------|-------|----------------------------------------------------------------------------------------------------------------------|------|
| Client       |        |                |        | โครงการ เอ็ม.เค.อพาร์ทเมนต์ |       |                                                                                                                      |      |
| Title        |        |                |        | SW-2536 For Factory         |       | Scale                                                                                                                | NTS. |
| Drawn        | Date   | Approved       | Date   | Drawing No.                 | Rev.  | <br><b>PROUD</b><br><b>ASIA</b> |      |
| Cholticha K. | 7-3-61 | <i>Umsamee</i> | 7-3-61 | Fac_053-2/61                | Rev.0 |                                                                                                                      |      |