


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT


STAR WATER STORAGE TANK (UNDERGROUND)

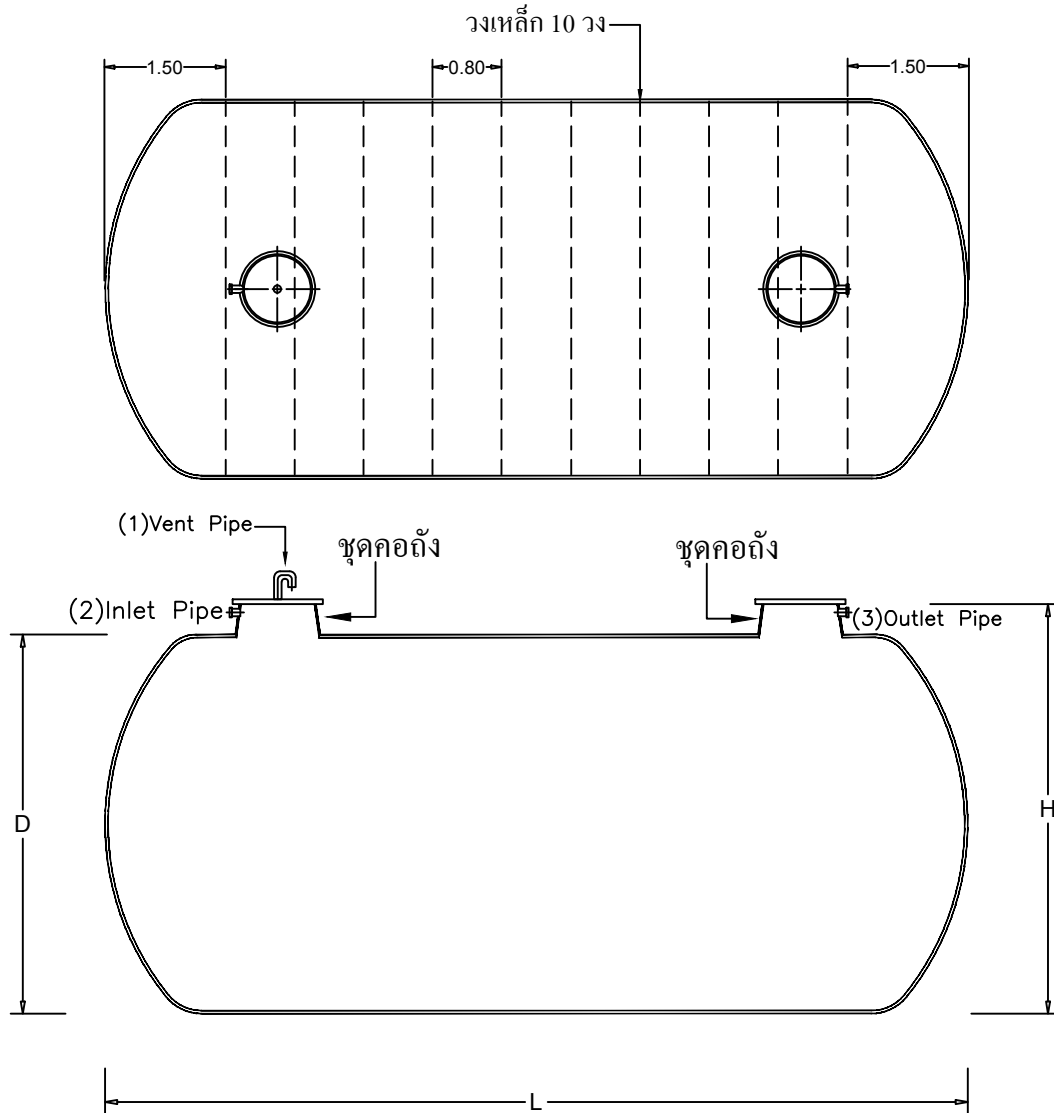

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
HRU-50K	10.20	2.70	2.50	Ø0.50	Ø2"	Ø3"	Ø2"

Client				โครงการ ถังเก็บน้ำชนิดฝังดิน			
Title				HRU-50K For Factory			
Scale				NTS.			
Drawn	Date	Approved	Date	Drawing No.	Rev.		
Cholticha K.	15-5-61	<i>Umsame</i>	15-5-61	Fac_099/61	Rev.0		



PROUD
ASIA