


Tolerance


<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

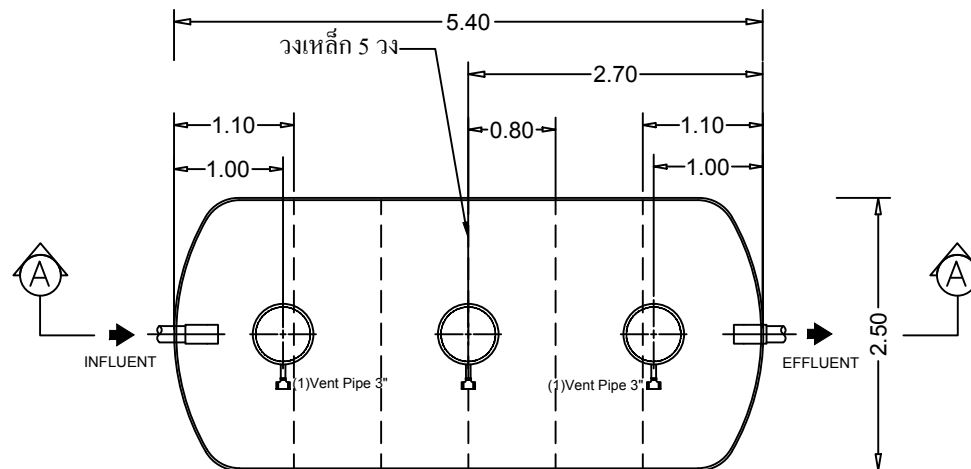

STAR TANK MODEL WSA-2525Z

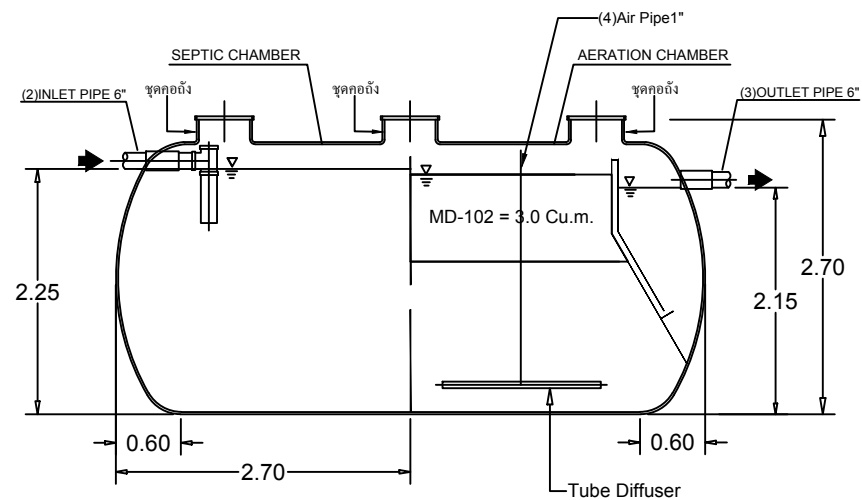

SECTION A-A

UNCONTROLLED DOCUMENT

Client					
โครงการ WAVE : ถังบำบัดน้ำเสียเดิมอากาศ					
Title				Scale	
STAR WSA-2525Z For Factory				NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.
Cholticha K.	23-5-61	<i>Wanwanee</i>	23-5-61	Fac_104-3/61	Rev.0

