



Tolerance	
<3.00	±0.01
>3.00	±0.02

UNIT = METER

STAR WATER STORAGE TANK MODEL WWTG-2000

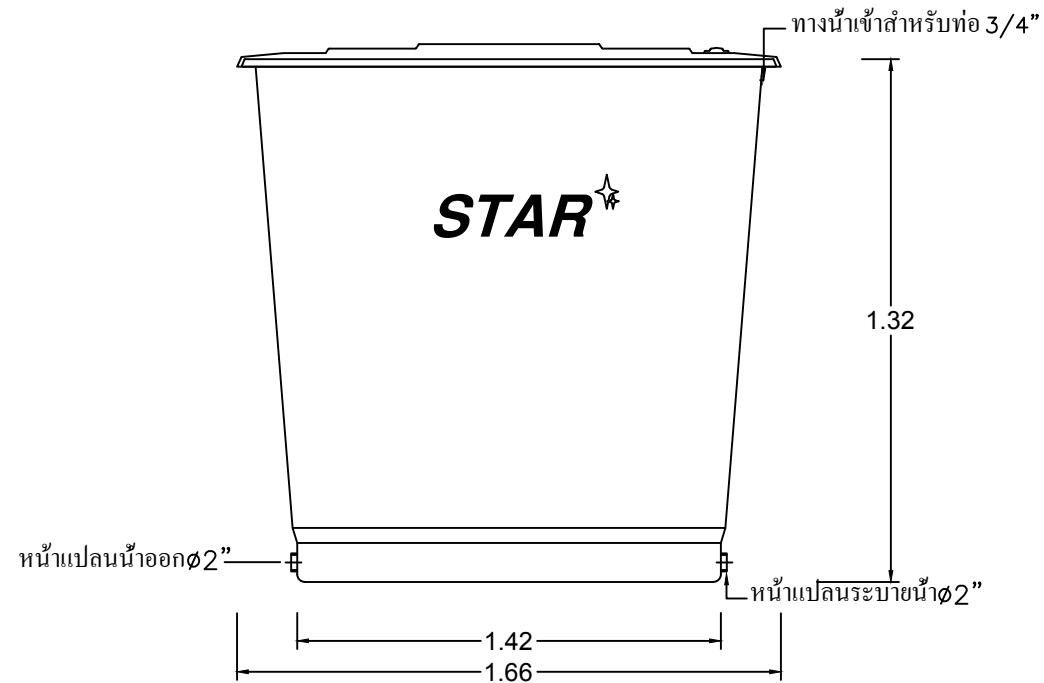

UNCONTROLLED DOCUMENT

Client						
โครงการ ถังเก็บน้ำบนดิน						
Title				Scale	NTS.	
STAR WATER TANK WWTG-2000 For Factory						
Drawn	Date	Approved	Date	Drawing No.	Rev.	
Chonticha	30-5-61	<i>Wanunee</i>	30-5-61	Fac_109/61	Rev.0	