

## Tolerance

&lt;3.00 ±0.01


&gt;3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

# STAR WATER STORAGE TANK

## (UNDERGROUND)

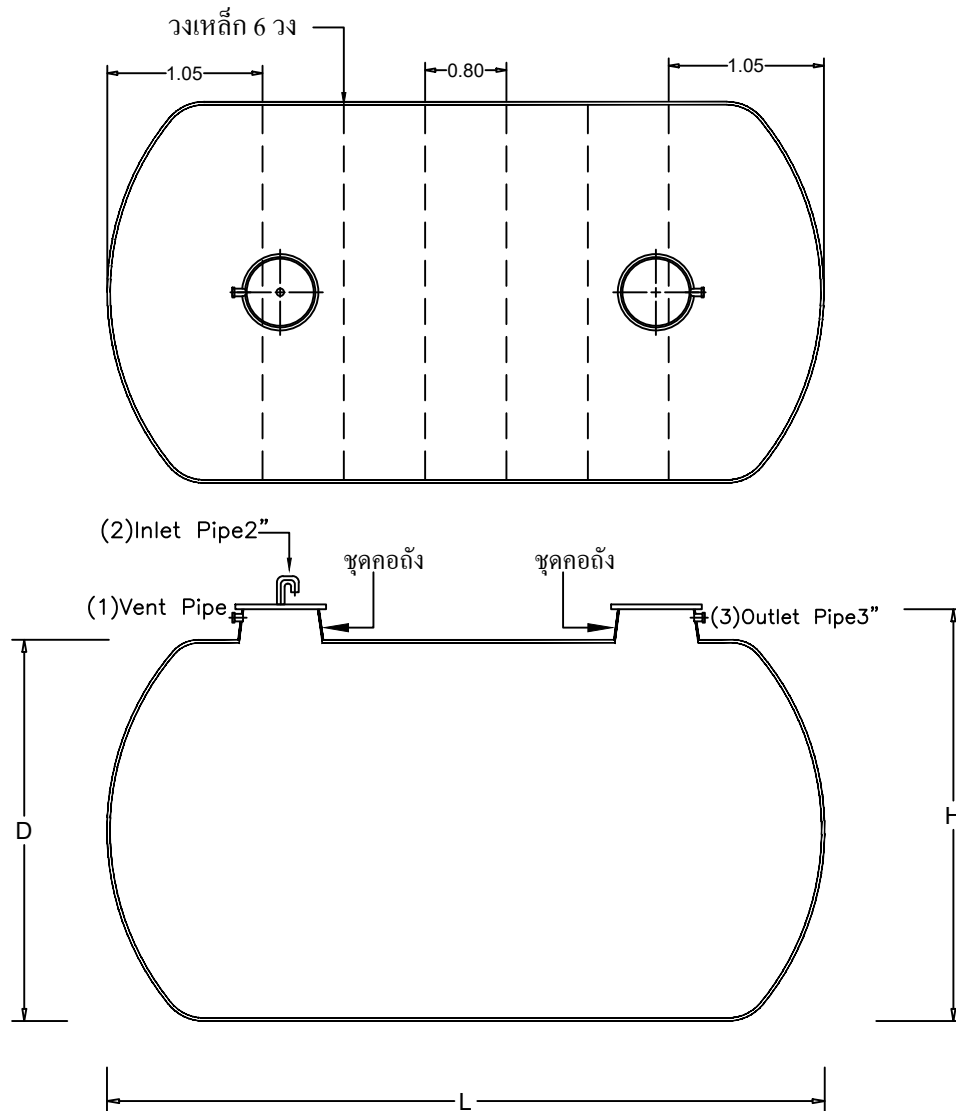

## SPECIFICATION

| MODEL   | LENGTH<br>(m.) | HEIGHT<br>(m.) | DIAMETER<br>(m.) | COVER<br>(m.) | INLET<br>(inc.) | OUTLET<br>(inc.) | AIR VENT<br>(inc.) |
|---------|----------------|----------------|------------------|---------------|-----------------|------------------|--------------------|
| SW-2017 | 6.10           | 2.15           | 2.00             | Ø0.50         | Ø2"             | Ø3"              | Ø2"                |