

Tolerance

<3.00 ±0.01


>3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK

(UNDERGROUND)

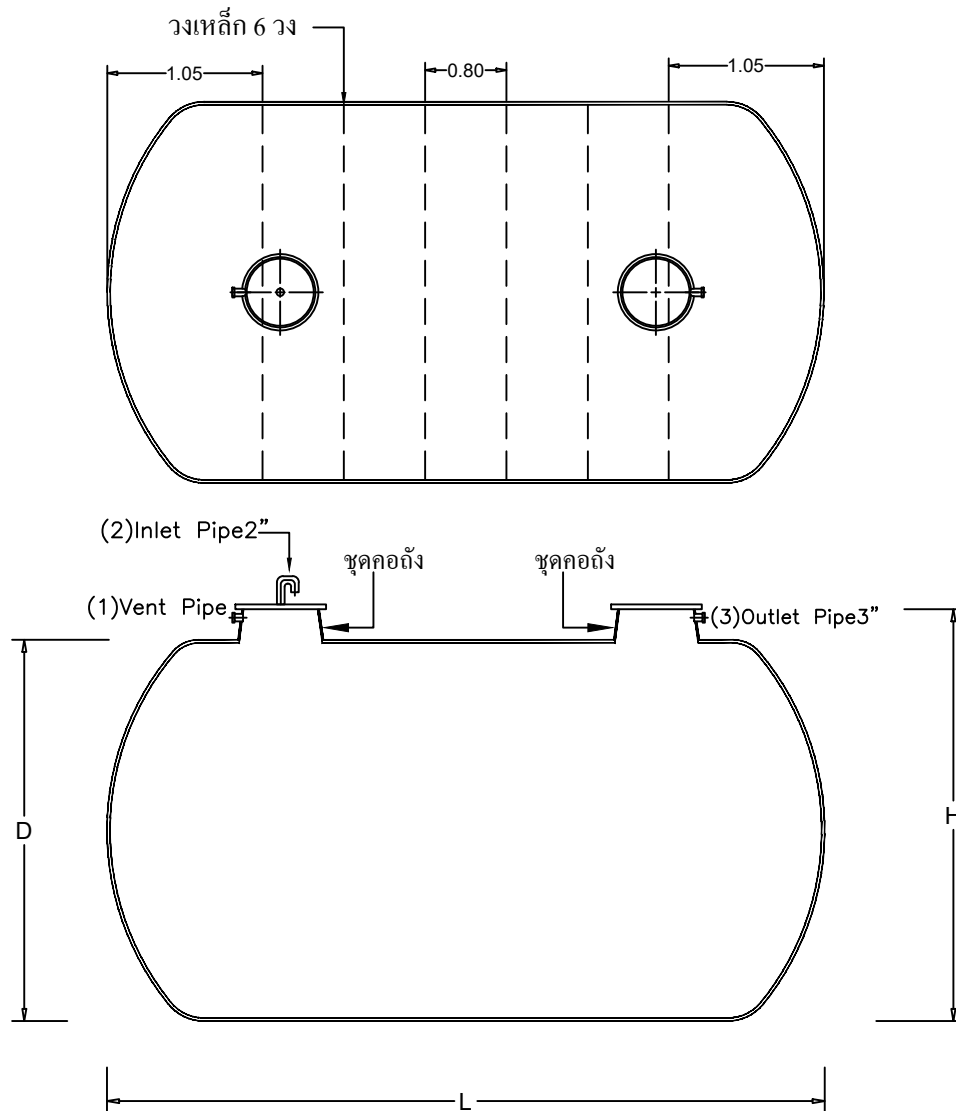

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SW-2017	6.10	2.15	2.00	Ø0.50	Ø2"	Ø3"	Ø2"

