



Tolerance	
<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

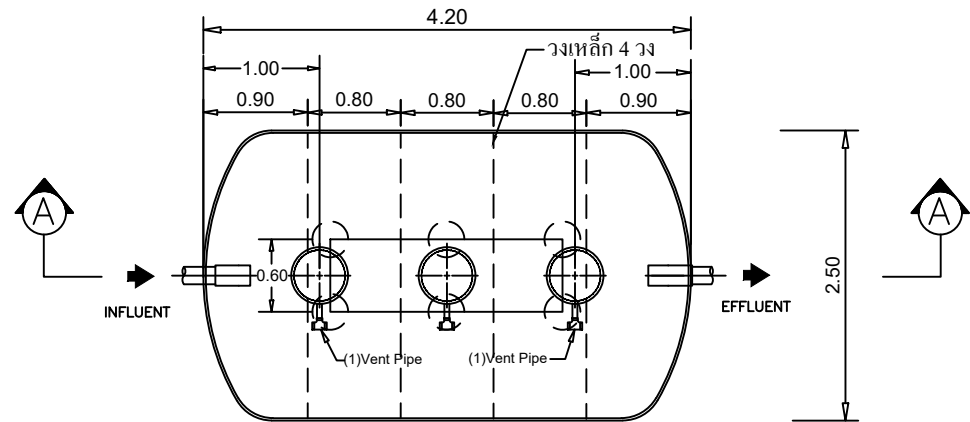

STAR TANK MODEL SSFA-2516Z

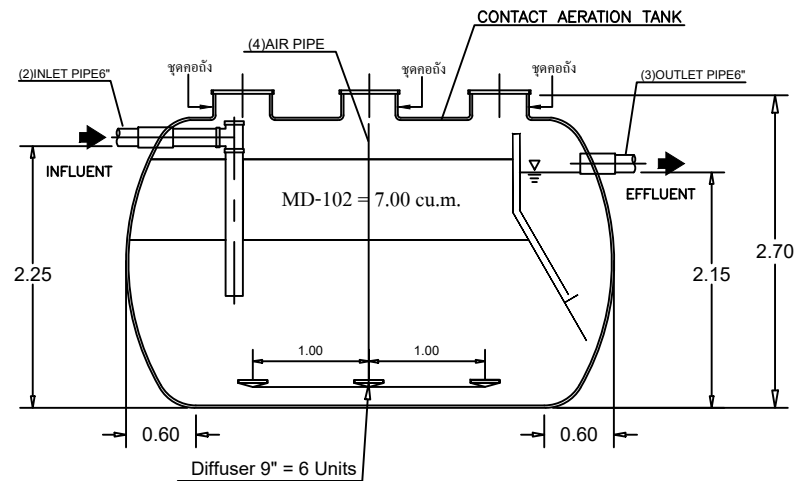

SECTION A-A

Air Blower : "AirFlow" Model HD-301S , 0.4 m3/d @3m. , 0.75kw. X 1 Set

UNCONTROLLED DOCUMENT

Client					
The Bell Pool Villa Resort Phuket					
Title				Scale	
STAR TANK MODEL SSFA-2516Z				NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	6-8-61	<i>Uthairat</i>	6-8-61	Fac_159/61	Rev.0

