


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

STAR TANK MODEL WSN-333

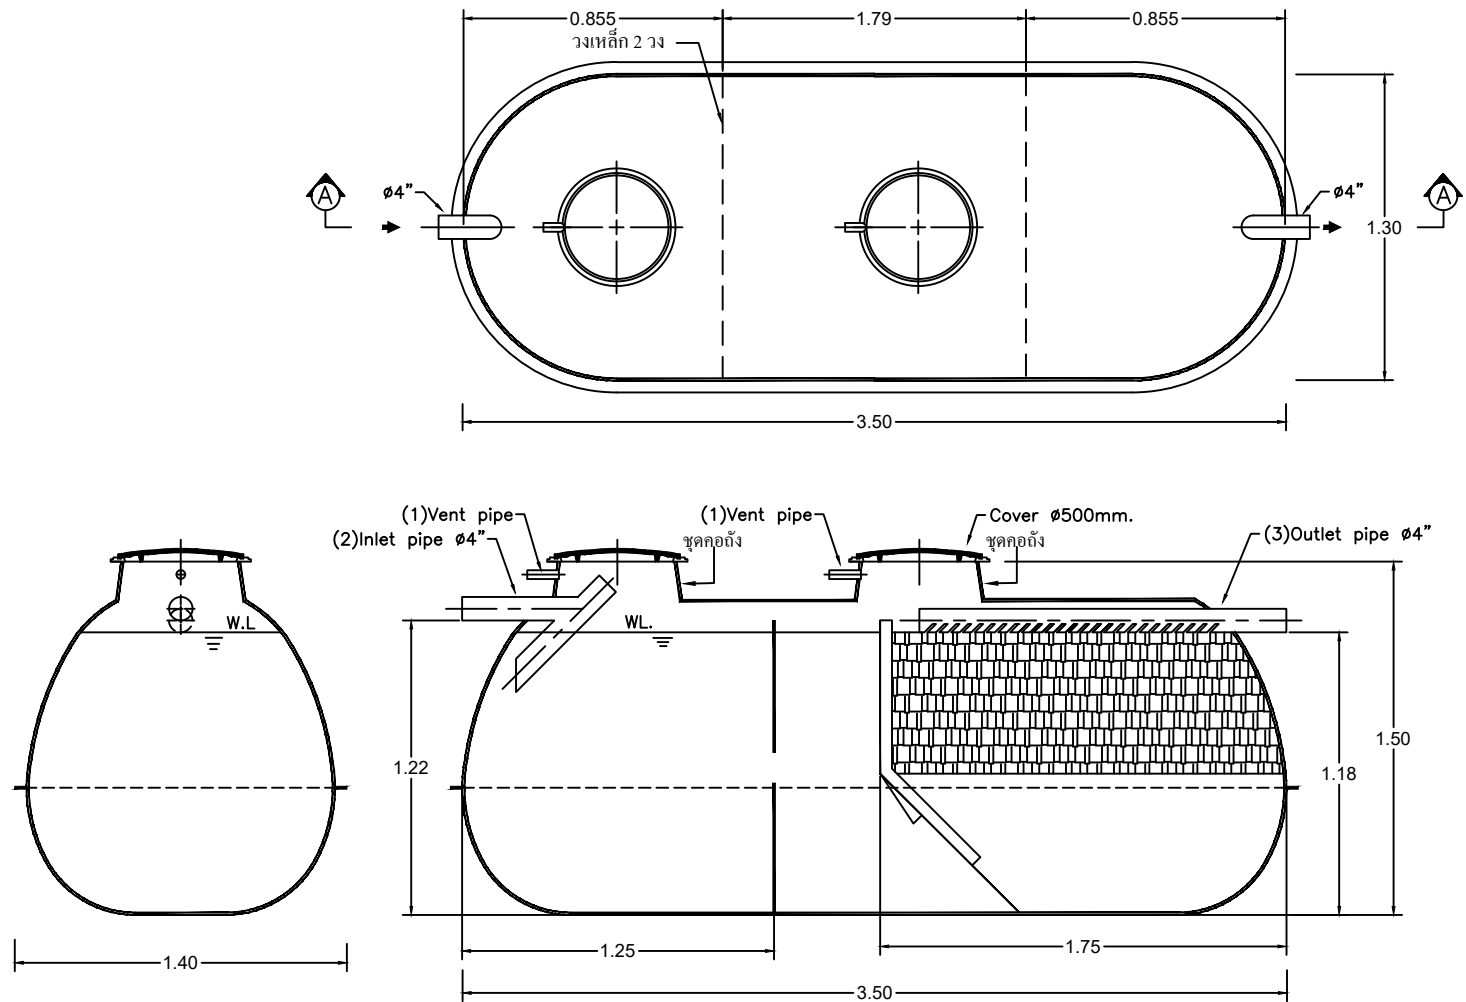

SECTION A-A

UNCONTROLLED DOCUMENT

Client		โครงการ ถังบำบัดน้ำเสีย			
Title		STAR WSN-333 For Factory			Scale NTS.
Drawn Chonticha	Date 17-9-61	Approved <i>Wanna</i>	Date 17-9-61	Drawing No. Fac_193/61	Rev. Rev.0

