


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

STAR TANK MODEL WSA-339

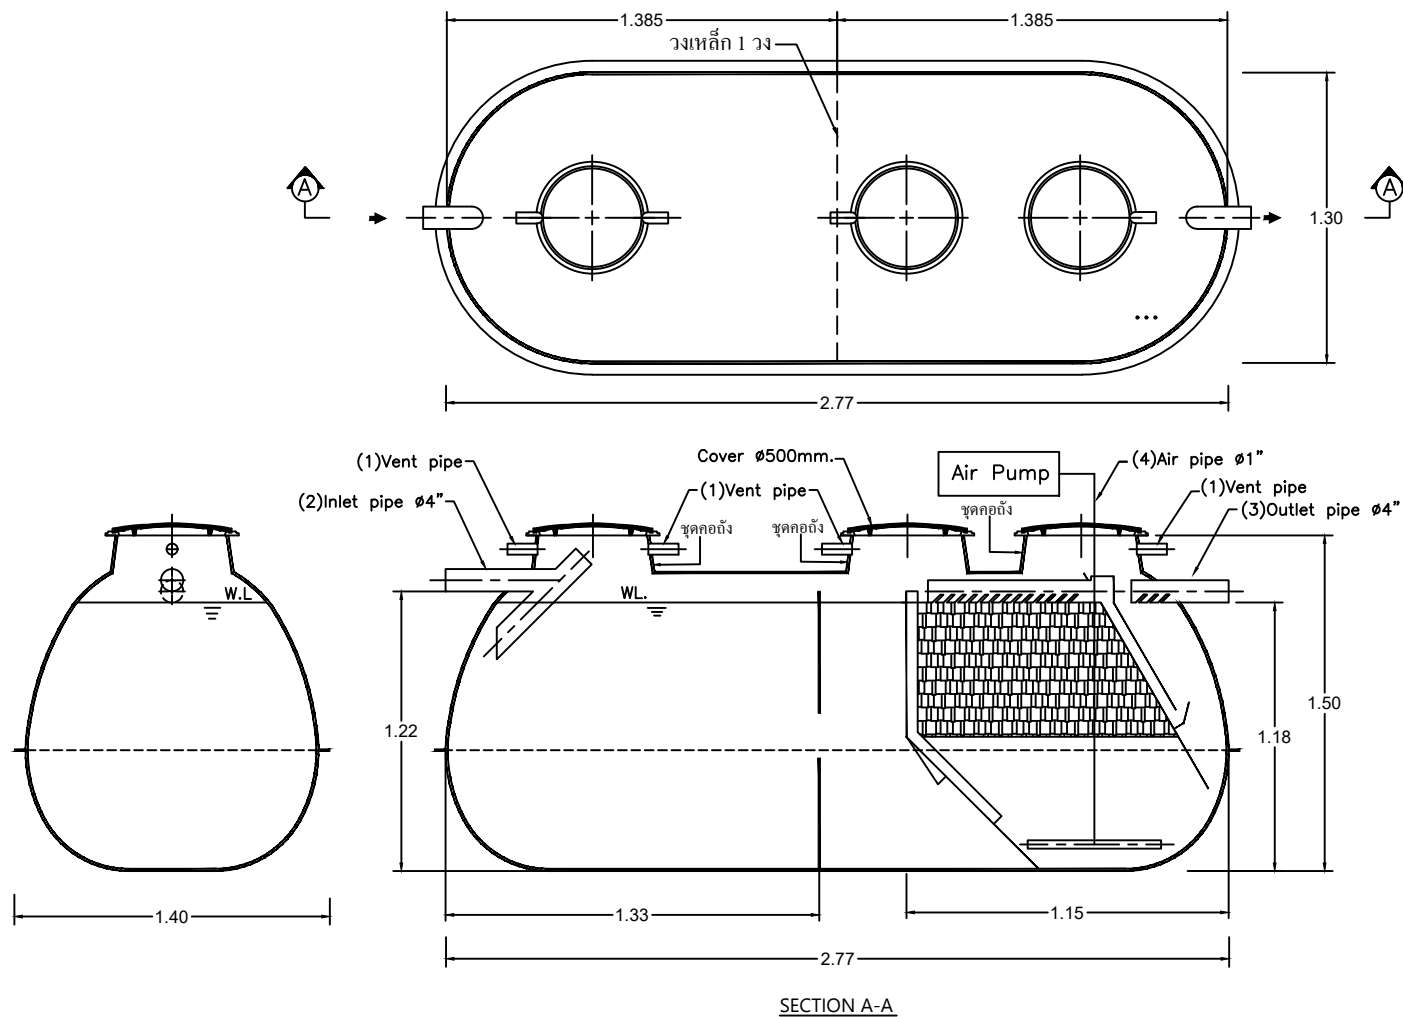

UNCONTROLLED DOCUMENT

Client					
โครงการ ถังบำบัดน้ำเสีย					
Title				Scale	
STAR WSA-339 For Factory				NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	20-9-61	Wanna	20-9-61	Fac_198/61	Rev.0

