| Tolerance | |
|---|---|
| <3.00 | ±0.01 |
| >3.00 | ±0.02 |

UNIT = METER

FM-DD-04

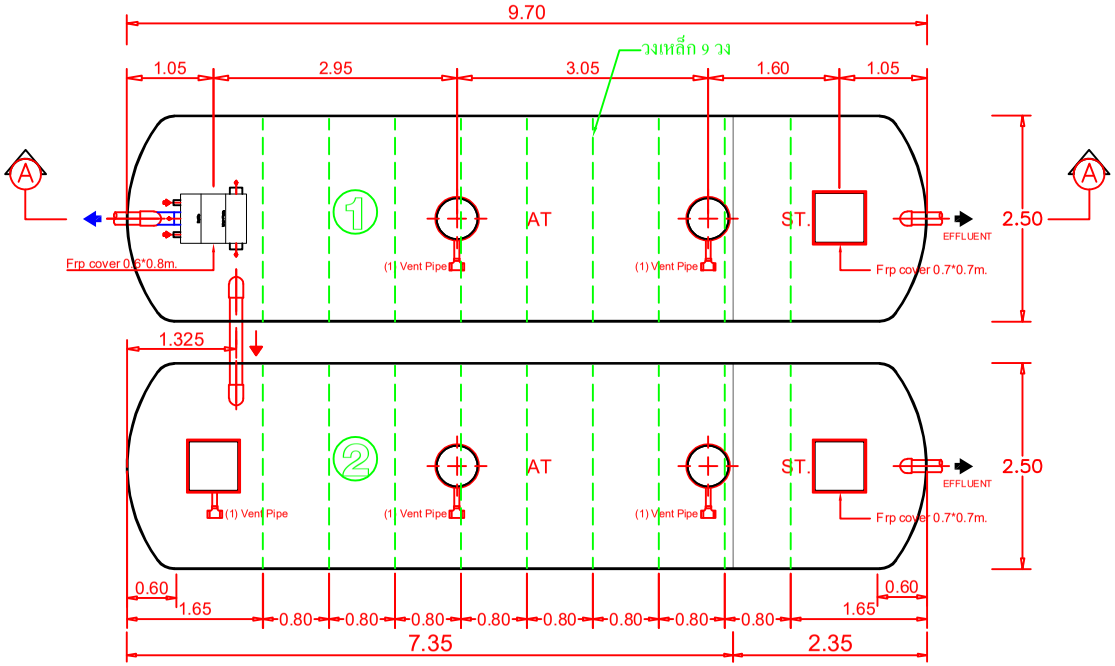


PLAN VIEW

Air blower 3 sets (run 2 stby 1)
"Taiko" SSR-65, 2.44cmm, at4.0m.,3.7kw, 3ph

Return Sludge pump 2 sets (1set/tank)
"ShinMaywa" CVS-40T, 0.25kw., 3ph

Air diffuser "MU" MAH-10 = 20 pcs.
Media pall ring-102 = 20 cu.,m.
Control panel = 1 set

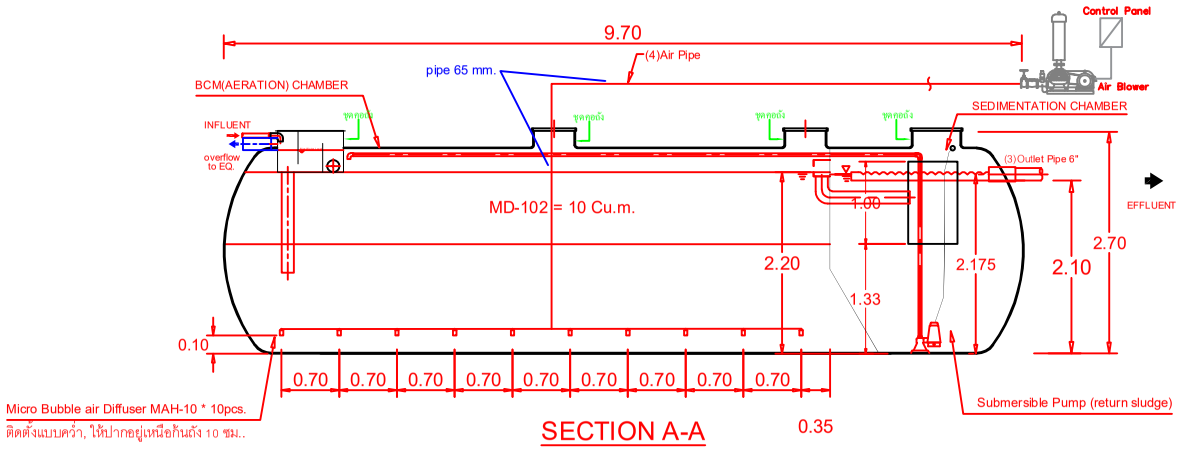


SECTION A-A

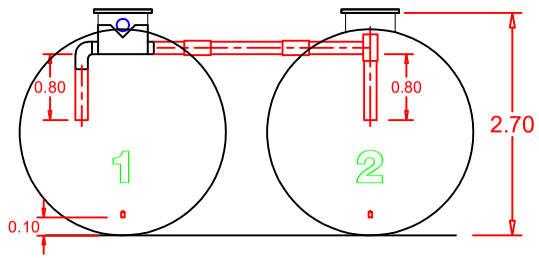


SIDE VIEW

UNCONTROLLED DOCUMENT

| Client | Grand Park Hotel / Mandalay | | | | | |
|---|---|---|---|---|---|---|
| Title | STAR TANK MODEL BCM-150A | | | | Scale NTS. | |
| Drawn Choticha | Date 2-10-61 | Approved | Date 2-10-61 | Drawing No. Fac_210/61 | Rev. Rev.0 | |

PROUD ASIA