


Tolerance


<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

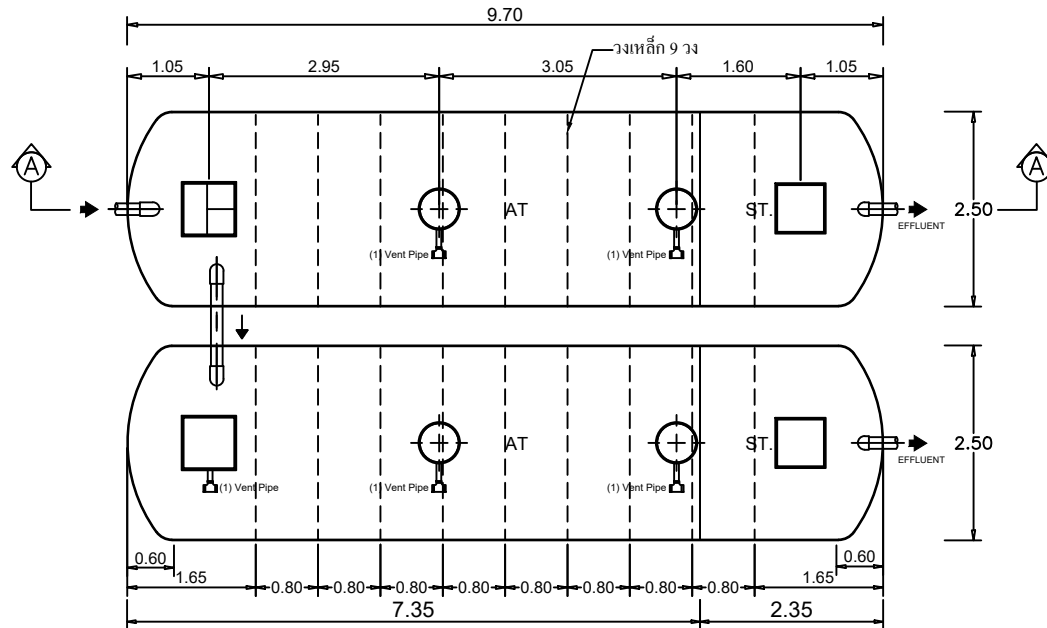


PLAN VIEW

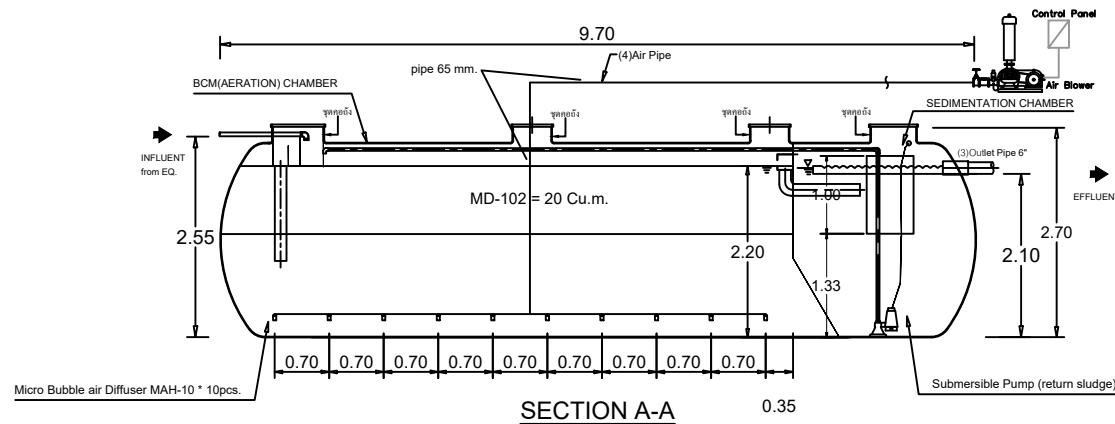

SECTION A-A

Air blower 3 sets (run 2 stby 1)
 "Taiko" SSR-65, 2.44cmm, at4.0m.,3.7kw, 3ph
 Return Sludge pump 2 sets (1set/tank)
 "ShinMaywa" CVS-40T, 0.25kw., 3ph
 Air diffuser "MU" MAH-10 = 20 pcs.
 Media pall ring-102 = 20 cu.,m.
 Control panel = 1 set

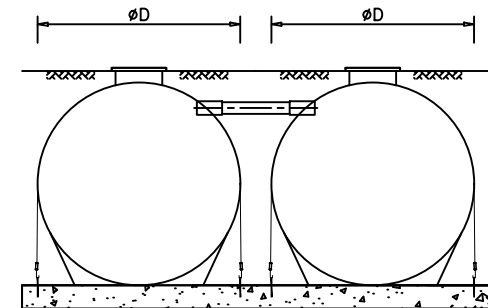

SIDE VIEW

UNCONTROLLED DOCUMENT

Client Grand Park Hotel / Mandalay					
Title STAR TANK MODEL BCM-150A				Scale NTS.	
Drawn Chotticha	Date 2-10-61	Approved [Signature]	Date 2-10-61	Drawing No. Fac_210/61	Rev. Rev.0

