


Tolerance	
<3.00	±0.01
>3.00	±0.02
UNIT = METER	

FM-DD-04

STAR TANK MODEL PS-11500A

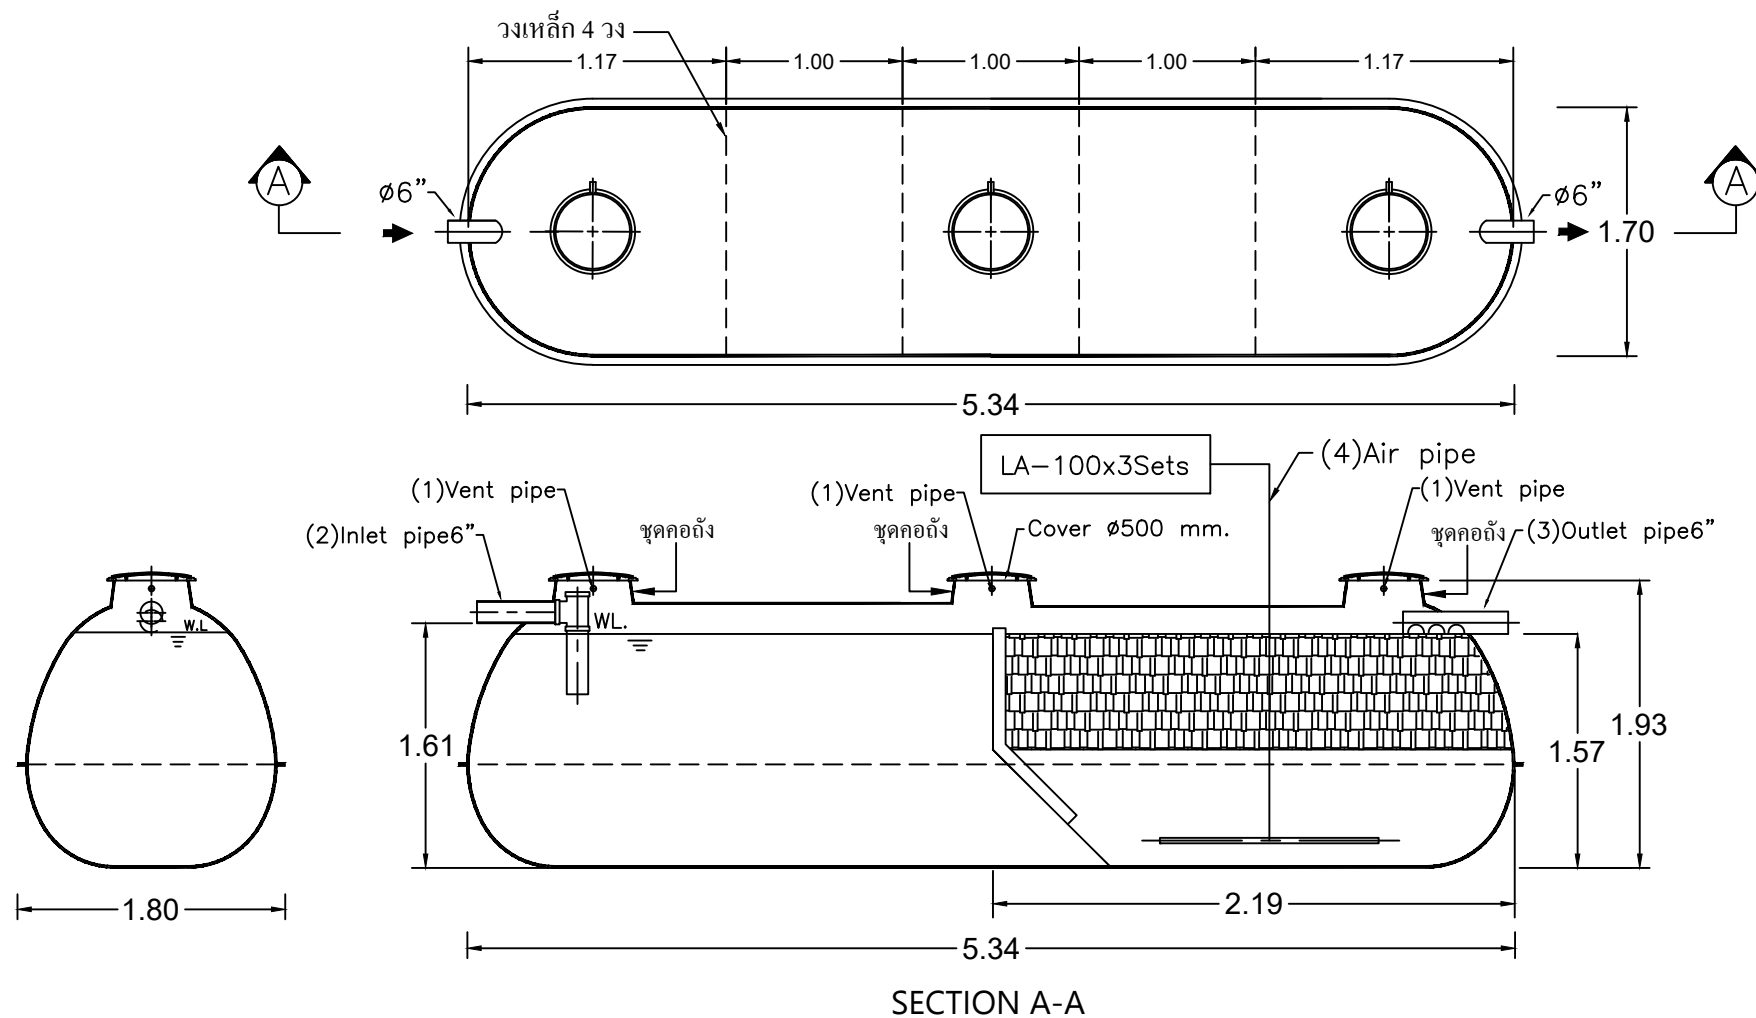

UNCONTROLLED DOCUMENT

Client							โครงการ ถังบำบัดน้ำเสีย	
Title							Scale	
STAR TANK MODEL PS-11500A For Factory							NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.			
Chonticha	8-10-61	<i>Wanna</i>	8-10-61	Fac_219/61	Rev.0			

