


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

STAR TANK MODEL WSN-333

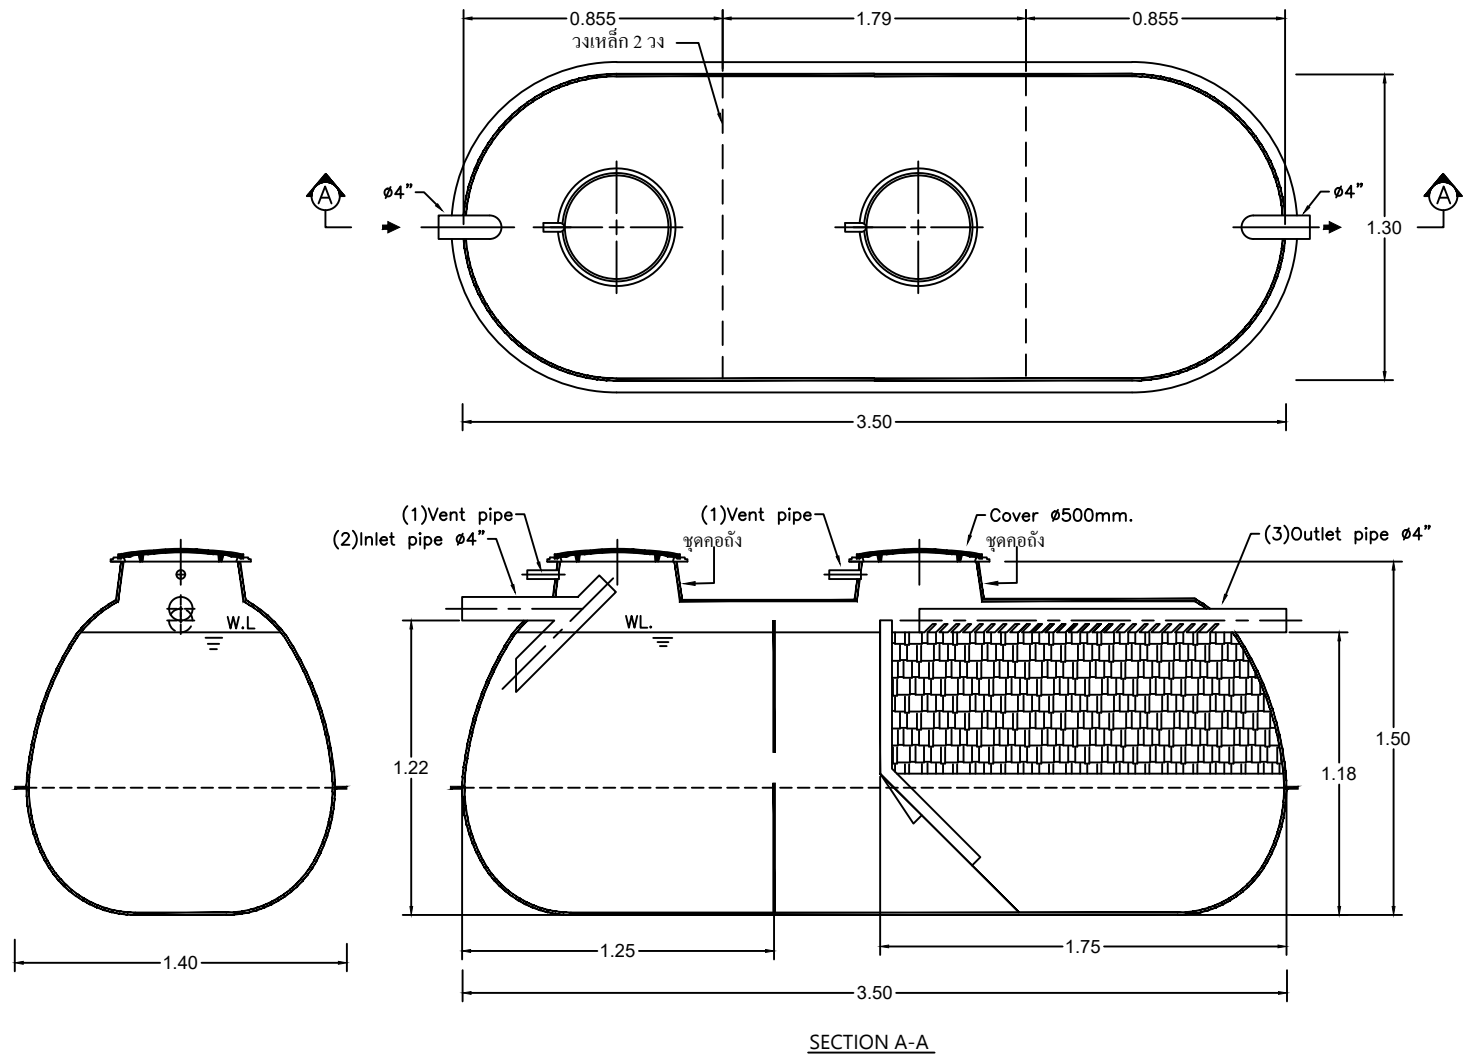

UNCONTROLLED DOCUMENT

Client		โครงการ ถังบำบัดน้ำเสีย				
Title		STAR WSN-333 For Factory			Scale NTS.	
Drawn	Date	Approved	Date	Drawing No.	Rev.	
Chonticha	17-10-61		17-10-61	Fac_225/61	Rev.0	