


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

STAR TANK MODEL WSA-375

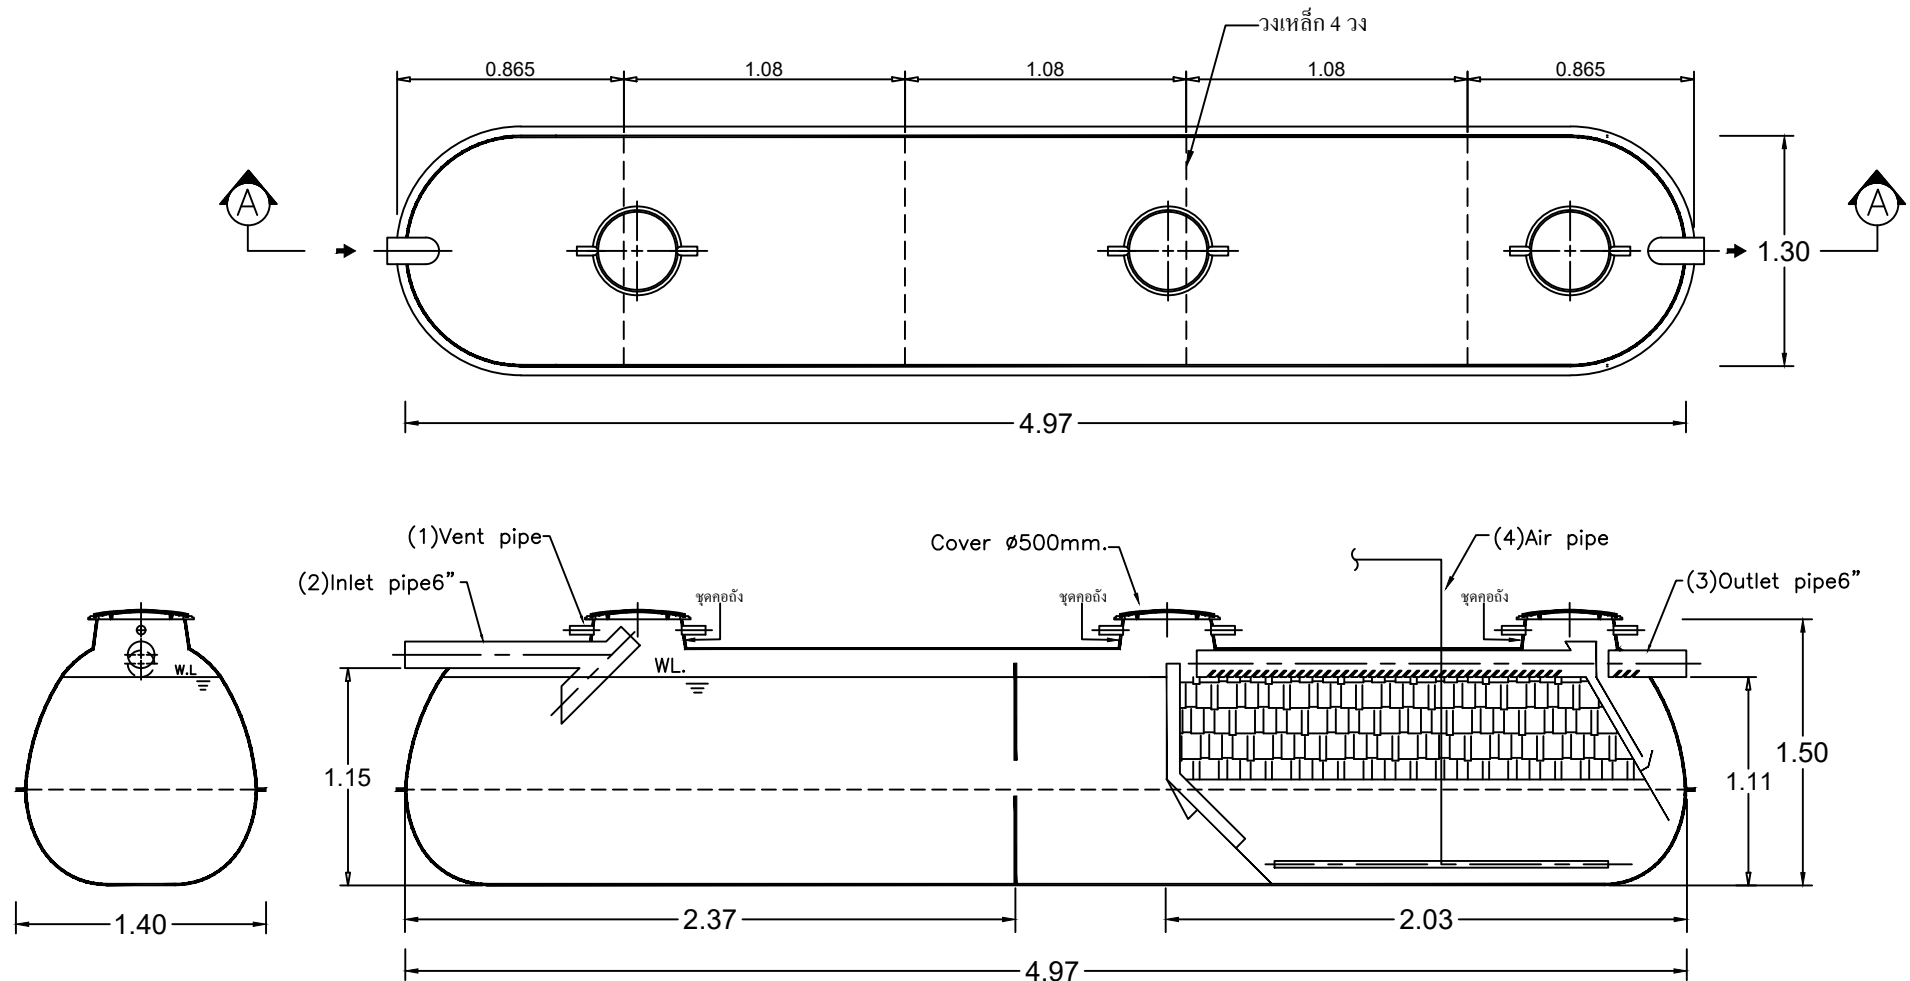

SECTION A-A

UNCONTROLLED DOCUMENT

Client		โครงการ ถังบำบัดน้ำเสีย			
Title		STAR WSA-375 For Factory			Scale NTS.
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	5-11-61	<i>Wanna</i>	5-11-61	Fac_237/61	Rev.0

