

Tolerance

<3.00 ±0.01


>3.00 ±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK


(UNDERGROUND)

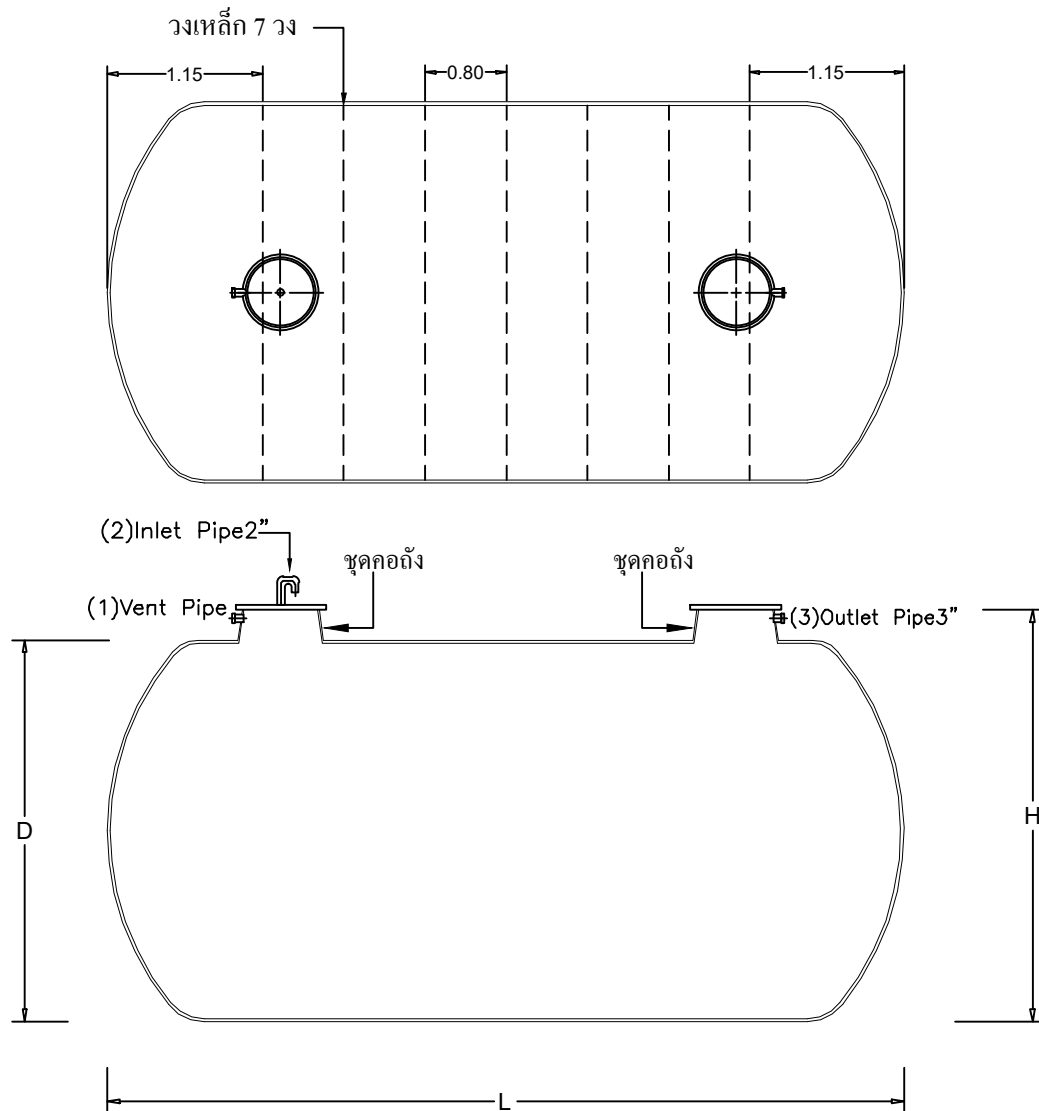

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SW-2020	7.10	2.15	2.00	Ø0.50	Ø2"	Ø3"	Ø2"

Client โครงการ อาคารที่ทำการ ต.ม.3 จ.ฉะเชิงเทรา					
Title SW-2020 For Factory				Scale NTS.	
Drawn Cholticha K.	Date 30-5-62	Approved <i>Wanna</i>	Date 30-5-62	Drawing No. Fac_109-2/62	Rev. Rev.0


PROUD
ASIA