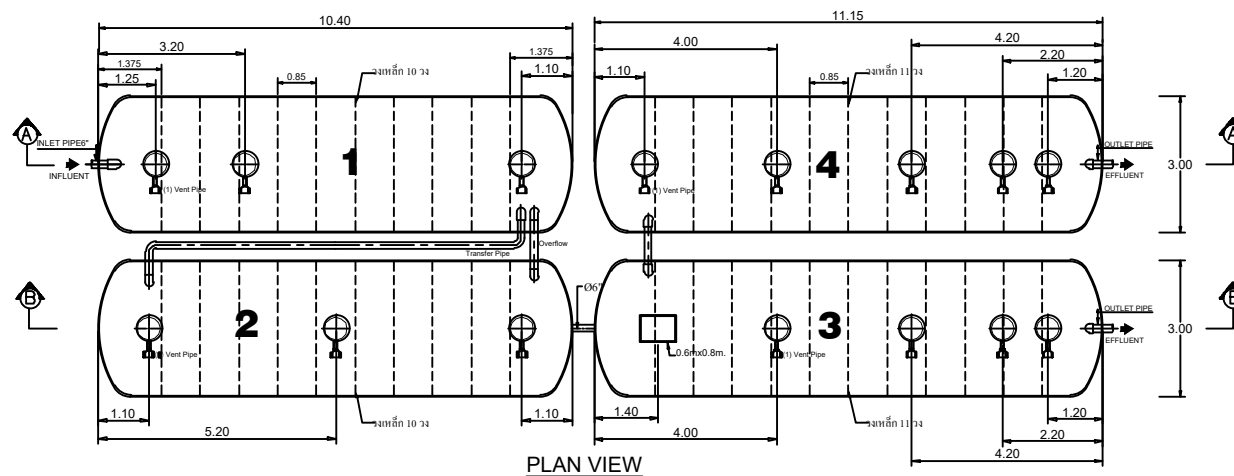
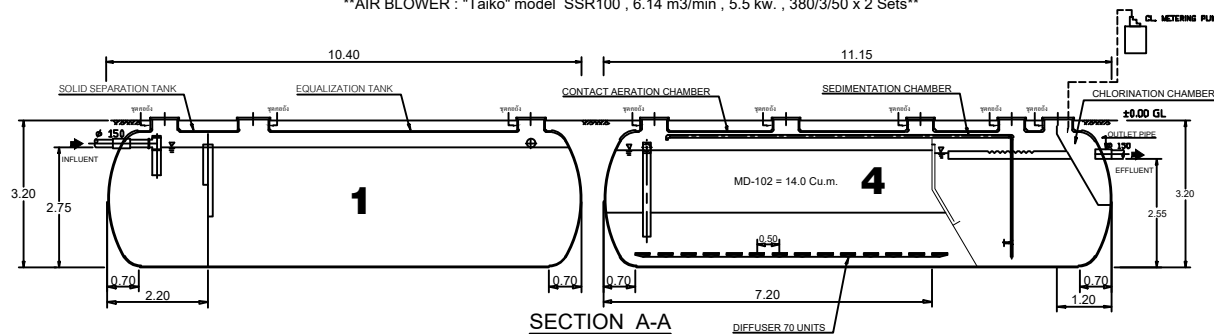


Tolerance


<3.00	±0.01
>3.00	±0.02

UNIT = METER

**AIR BLOWER : "Taiko" model SSR100 , 6.14 m³/min , 5.5 kw. , 380/3/50 x 2 Sets**

Chlorine Metering Pump "Prominent" model CNPB1000PVT x 2 Set

PE Tank 500 Litres x 2 Tanks

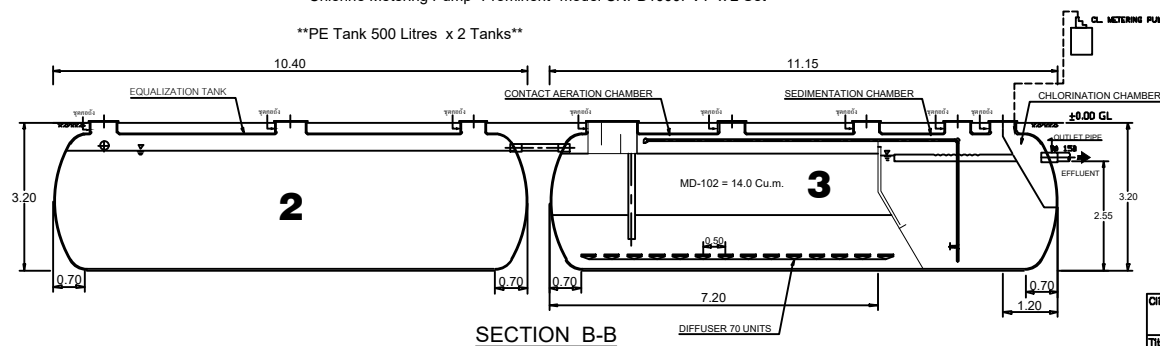

UNCONTROLLED DOCUMENT

Client					
โครงการ โรงพยาบาลกะปงชัยพัฒน์ จ.พังงา					
Title				Scale	NTS.
STAR TANK MODEL C-30280C					
Drawn	Date	Approved	Date	Drawing No.	Rev.
CHOLTHA K.	28-6-62	<i>[Signature]</i>	28-6-62	Fm_131/62	Rev.0

