


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

STAR WATER STORAGE TANK (ONGROUND)

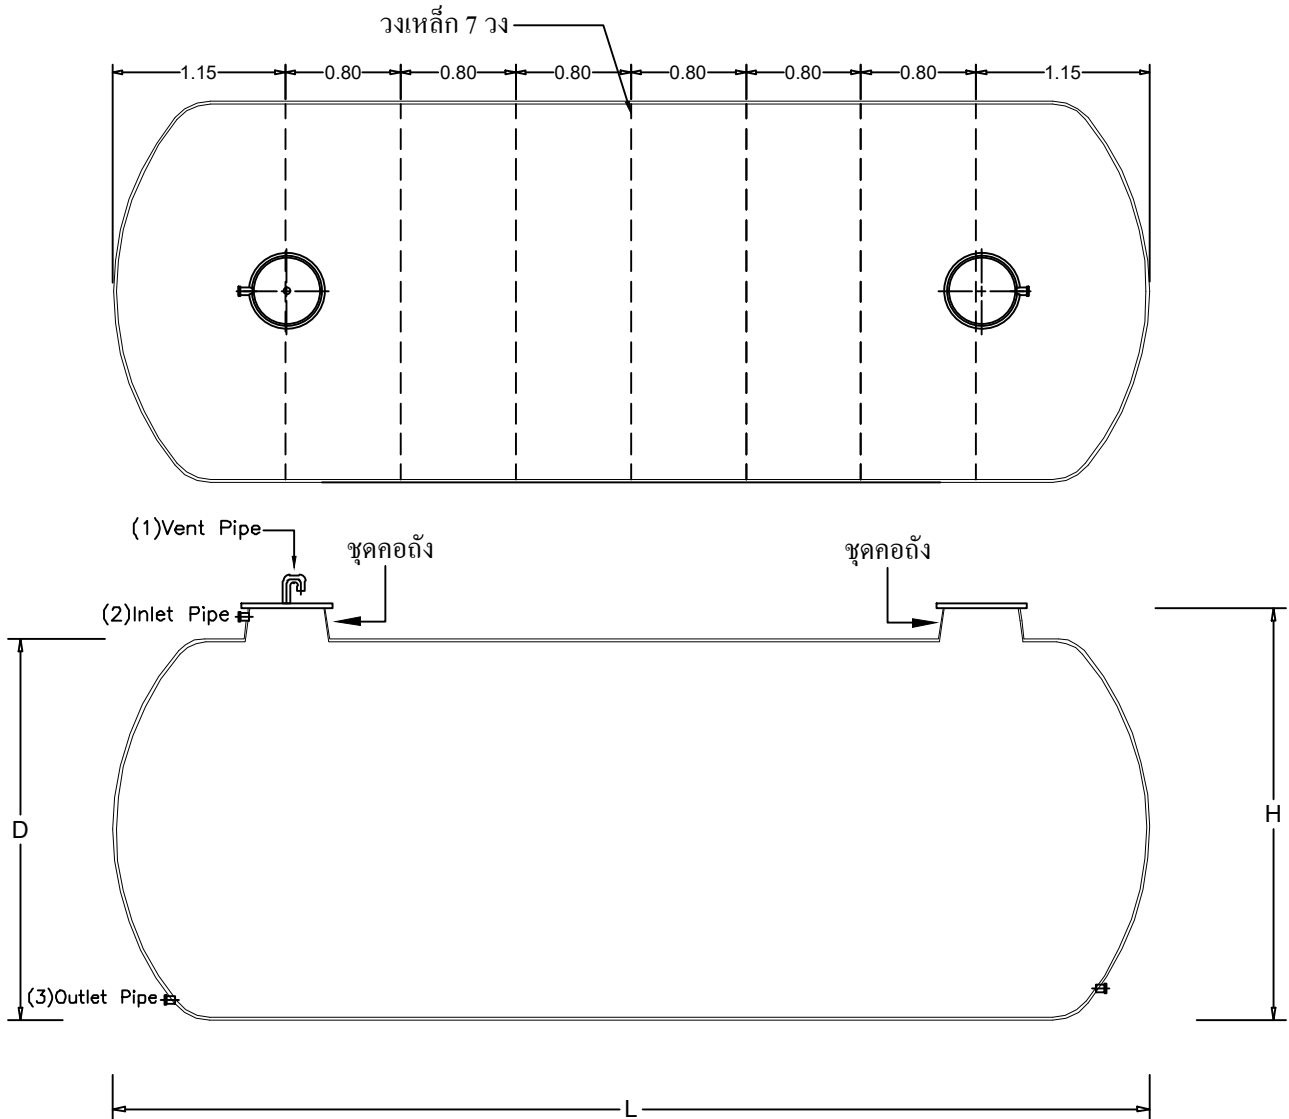

SPECIFICATION

MODEL	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (inc.)	OUTLET (inc.)	AIR VENT (inc.)
SWO-2020	7.10	2.15	2.00	Ø0.50	Ø2"	Ø3"	Ø2"

Client				โครงการ Harmony & IRPC		
Title				SWO-2020 For Factory		Scale NTS.
Drawn Cholticha K.	Date 30-7-62	Approved <i>Wanna</i>	Date 30-7-62	Drawing No. Fac_153-1/62	Rev. Rev.0	 PROUD ASIA