



Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

FM-DD-04

STAR TANK MODEL WSA-3100

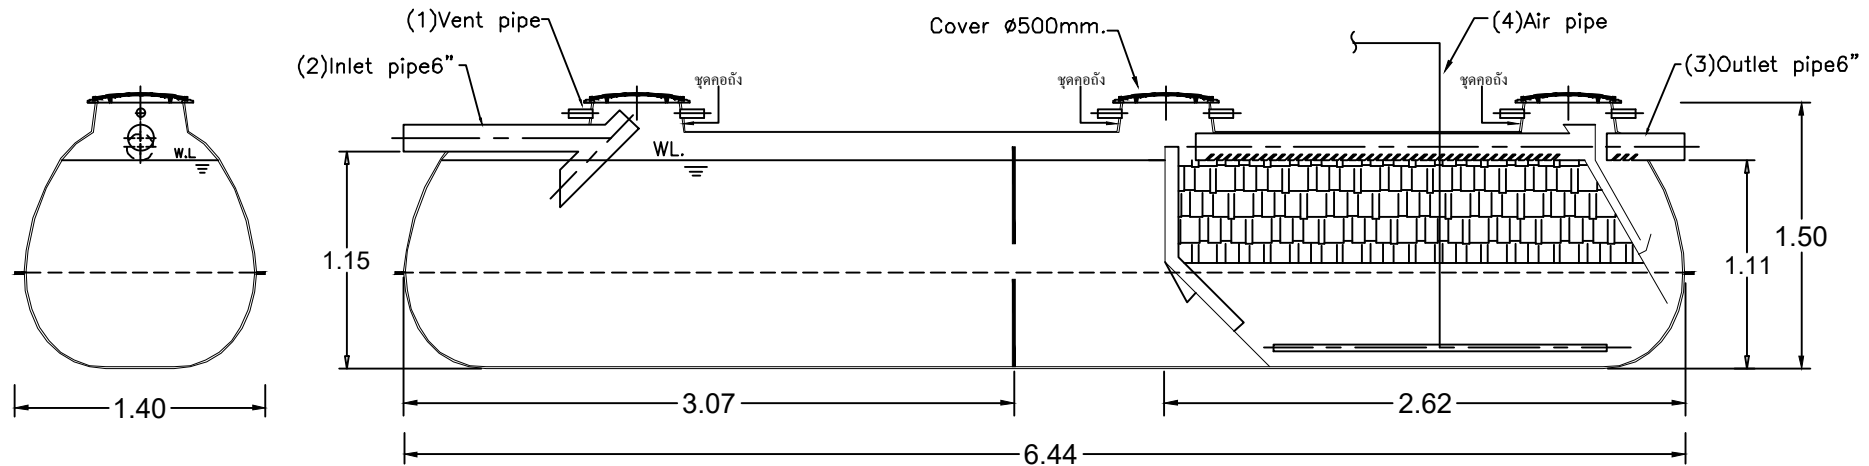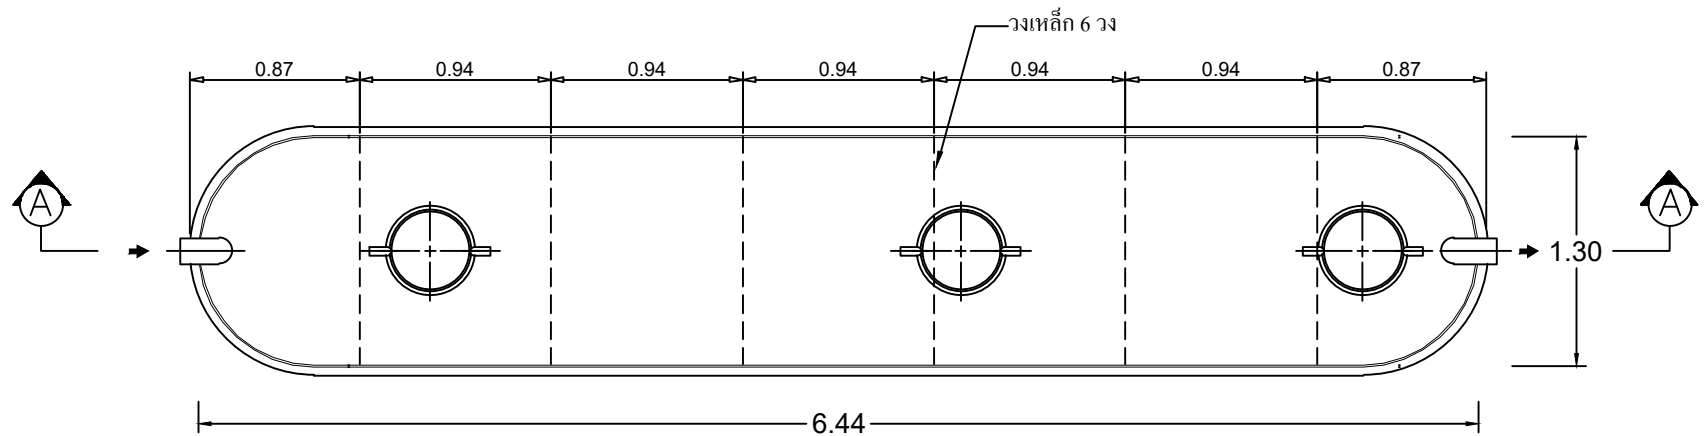

SECTION A-A

UNCONTROLLED DOCUMENT

Client		โครงการ Wave : ถังบำบัดน้ำเสีย			
Title		STAR WSA-3100 For Factory			Scale
					NTS.
Drawn	Date	Approved	Date	Drawing No.	Rev.
Chonticha	31-7-62	Wanna	31-7-62	Fac_154/62	Rev.0

