



Tolerance

|       |       |
|-------|-------|
| <3.00 | ±0.01 |
| >3.00 | ±0.02 |


UNIT = METER

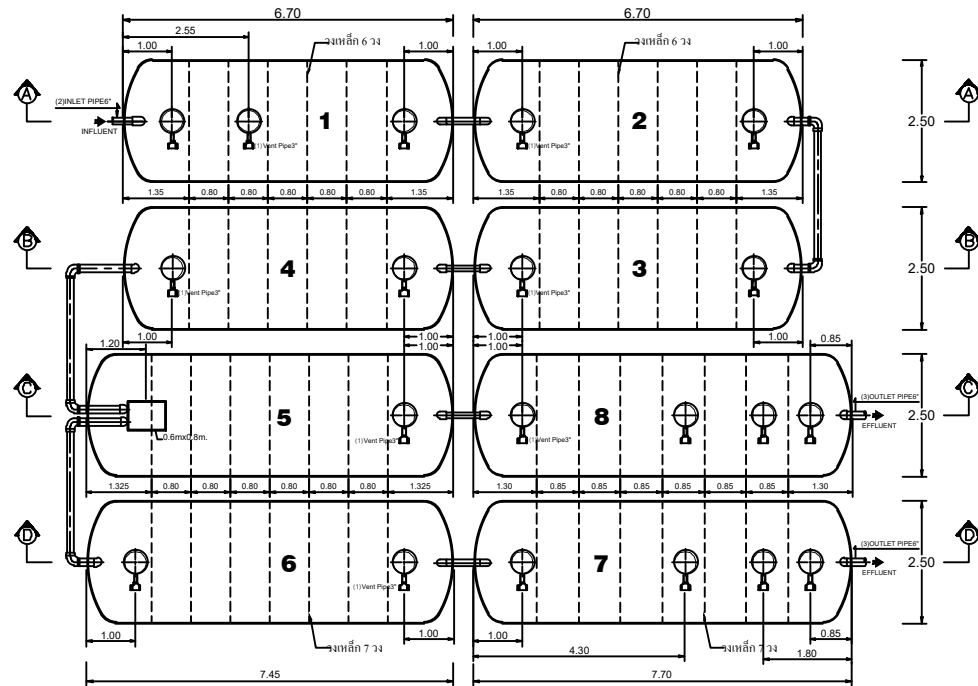


PLAN VIEW

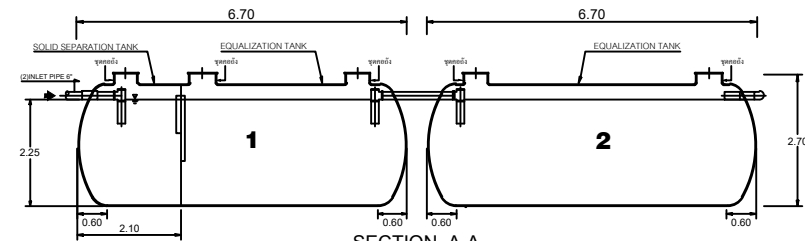


SECTION A-A

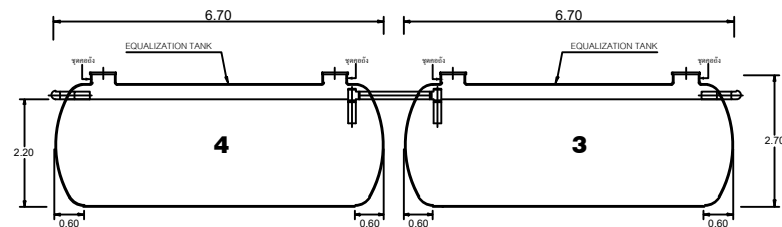

SECTION B-B

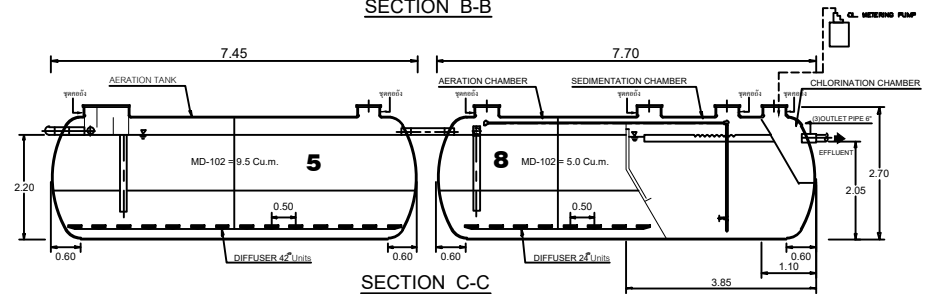

SECTION C-C

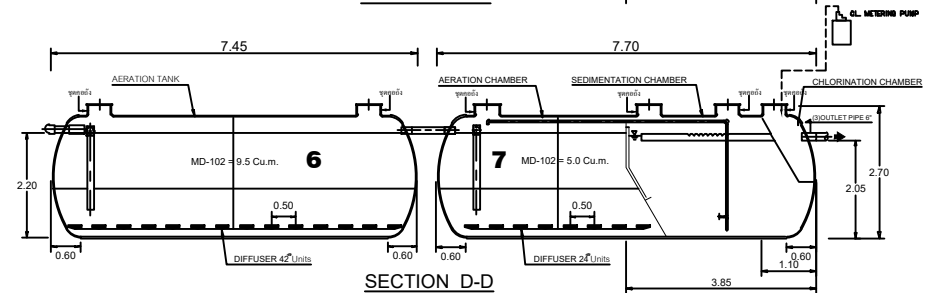

SECTION D-D

UNCONTROLLED DOCUMENT

\*\*AIR BLOWER : "Taiko" model SSR100 , 6.14 m3/min , 5.5 kw. , 380/3/50 x 2 Sets\*\*

\*\*Chlorine Metering Pump "Prominent" model CNPB1000PVT x 2 Set\*\*

\*\*PE Tank 500 Litres x 2 Tanks\*\*

\*\*ตู้ควบคุมไฟฟ้า 1 ตู้\*\*

|            |          |                                                                                       |          |             |       |                                                                                                                |  |
|------------|----------|---------------------------------------------------------------------------------------|----------|-------------|-------|----------------------------------------------------------------------------------------------------------------|--|
| Client     |          | โครงการ โรงพยาบาลเกาะราชย์พัฒนา จ.พังงา                                               |          |             |       | <br><b>PROUD<br/>ASIA</b> |  |
| Title      |          | STAR TANK MODEL C-25280C                                                              |          |             |       |                                                                                                                |  |
|            |          |                                                                                       |          |             |       | Scale<br>NTS.                                                                                                  |  |
| Drawn      | Date     | Approved                                                                              | Date     | Drawing No. | Rev.  |                                                                                                                |  |
| CHOLTHA K. | 12-11-62 |  | 12-11-62 | Fao_230/62  | Rev.0 |                                                                                                                |  |

