


Tolerance

<3.00	±0.01
>3.00	±0.02

UNIT = METER

UNCONTROLLED DOCUMENT

FM-DD-04

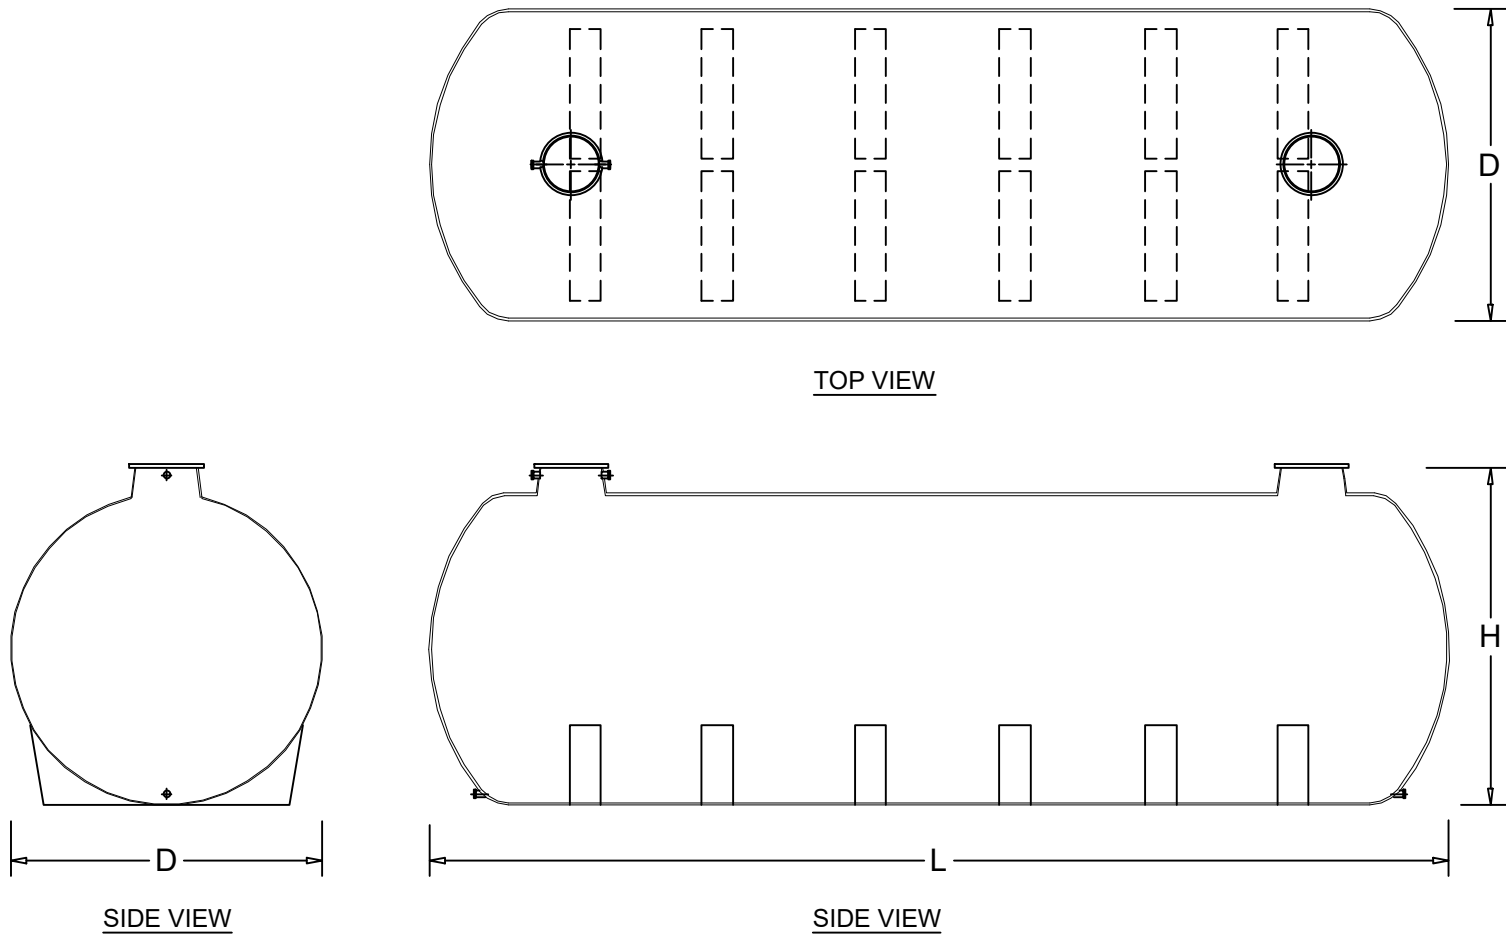

SPECIFICATION

MODEL	CAPACITY (Cu.m.)	LENGTH (m.)	HEIGHT (m.)	DIAMETER (m.)	COVER (m.)	INLET (Inc.)	OUTLET (Inc.)	AIR VENT (Inc.)	Material	Certification
SWO-3585	85.3	9.90	3.70	3.50	ø0.60	ø2"	ø2"	ø2"	FRP.	ISO9001 V2015 TIS435-2548

Clientโครงการ Tesco Lotus บางกะดี										
TitleSTAR Water Storage Tank Model SWO-3585								ScaleNTS.		
DrawnChonticha	Date9-4-63	ApprovedWassana	Date9-4-63	Drawing No.Fac_049-2/63		Rev.Rev.0				